

# ENVIRON

May 24, 2011

NPDES Compliance Coordinator  
State of Nevada Division of Environmental Protection  
Bureau of Water Permits & Compliance  
901 South Stewart Street, Suite 4001  
Carson City, Nevada 89701-5249

Re: Revised Discharge Monitoring Report (DMR) – March 2011 – NPDES Permit  
NV0023060


Dear Sirs:

Nevada Environmental Response Trust (NERT) maintains an NPDES Permit #0023060 for discharge of treated water, as part of their on-going effort to remediate perchlorate in the Henderson area. The attached amended March 2011 (Attachment 1) reflects information associated with the remediation efforts, i.e. surface discharge of treated groundwater near the Las Vegas Wash. Supporting analytical reports are included in Attachment 2, in electronic format on a CD. Please note this March 2011 DMR has been prepared with analytical received after the April 28, 2011 required submittal date. All analytical has been received at this time and the attached report is complete.

During March 2011 the biological perchlorate remediation process continued to demonstrate compliance with the 18 ug/l (ppb) permit limit for a monthly average concentration of total perchlorate concentration.

Should you have any questions concerning this report, please contact Susan Crowley at (702) 592-7727 cell or e-mail [smcrowley@cox.net](mailto:smcrowley@cox.net). Thank you.

Sincerely,



Allan J. DeLorme, PE  
Managing Principal

Attachments

Overnight Mail

cc: Please see attached distribution sheet



C:\SMC\My  
Documents\Document

# Tronox Document Distribution List

Updated: 25-Apr-11


Document Name: Compliance Report Distribution - addressee highlighted in yellow

Name		Firm	Distribution		
(Last, First)			Hard	e-Copy	Comment
Compliance Coordinator		NDEP	X	X	digital analytical
Knight	William	NDEP			
Sous	Nadir	NDEP		X	
Tinney	Al	NDEP			
Palm	Jon	NDEP		X	
Harbour	Shannon	NDEP		X	
Najima	Jim	NDEP			
Hackenberry	Paul	Hackenberry			
Black	Paul	Neptune			
Copeland	Teri				
Otani-Fehling	Joanna	Neptune			
Fehling	Kurt	Fehling Group			
McGinley	Joe	McGinley			
Gratson	Dave	Neptune			
Lovato	Greg	NDEP			
Giroux	Brian	McGinley			
Rakvica	Brian	McGinley			
Pohlmann	Brenda	COH			
Conaty	Barry	COH Counsel			
Paris	Mark	BMI			
Preslo	Lynne	Montrose			
Waggle	Brian	Montrose			
Kaplan	Mitch	EPA, Reg 9			
Tyson	Victoria	Timet			
Wilkinson	Craig	Timet			
Pogoncheff	Nick	Stauffer			
Madiano	Ed	de maximis			

Name		Firm	Distribution		
(Last, First)			Hard	e-Copy	Comment
Crowley	Susan	Crowley Environmental	X	X	
Bailey	Keith	Environmental Answers			
Krish	Ed	Hydrogeologist		X	
Paque	Matt	Tronox Counsel			
Stater	Rick	Tronox			
Skromyda	Mike	Tronox			
Chambers	Deni	Northgate			IN HOUSE
Willis	Derrick	Northgate			
Donnelly	Dara	Northgate			
Arnold	Cindy	Northgate			DVSR hard cc
DeLorme	Allan	Environ		X	
Knox	Craig	Environ		X	
Steinberg	Andrew	Trust		X	
Pekala	John	Environ		X	
Ritchie	Chris	Environ		X	
Travers	Mark	Environ		X	
Stowers	Kirk	Broadbent			
Sahu	Rahnijit	BMI			
Crouse	George	Syngenta			
Erickson	Lee	Stauffer			
Kelly	Joe	Montrose			
Sundberg	Paul	Montrose			
Gibson	Jeff	AmPac			
Richards	Curt	Olin			
Bellotti	Michael	Olin			

**NPDES Permit NV0023060 – Revised March 2011 DMR  
CEM Certification**

I hereby certify that I am responsible for the services described in this document and for the preparation of this document. The services described in this document have been provided in a manner consistent with the current standards of the profession and, to the best of my knowledge, comply with all applicable federal, state and local statutes, regulations and ordinances.

 5-24-11  
\_\_\_\_\_  
Susan Crowley  
CEM 1428, expires 3-8-13

# **ATTACHMENT 1**

## **Discharge Monitoring Reports (DMR)**

11 March DMR -  
revised.xlsx

**Revised March 2011**

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

PERMITTEE NAME/ADDRESS

Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015

NV 0023060  
 PERMIT NUMBER

001  
 DISCHARGE NUMBER

Facility: Nevada Environmental Response Trust

Location: Henderson, NV

Attn: Susan M. Crowley

MONITORING PERIOD						
YEAR	MO	DAY	YEAR	MO	DAY	
FROM	11	03	TO	11	03	31

NO DISCHARGE

NOTE: Read instructions before completing this form

PARAMETER		QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS			
Flow Effluent	SAMPLE MEASUREMENT	1.38	1.39	MGD	*****	*****	*****		0	Cont	Flow Meter
	PERMIT REQUIREMENT	1.45 MGD Maximum	1.75 MGD Maximum		*****	*****	*****				
BOD5 (Inhibited) Influent	SAMPLE MEASUREMENT	*****	*****	****	1.9	3.5	22.19	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
BOD5 (Inhibited) Effluent	SAMPLE MEASUREMENT	*****	*****	****	4.2	6.7	48.93	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	25 mg/L	40 mg/L	254 lbs/day				
Perchlorate FBR Influent	SAMPLE MEASUREMENT	*****	*****	****	143	150	1,670	MG/L	0	Weekly	Comp
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
Perchlorate FBR Effluent	SAMPLE MEASUREMENT	*****	*****	****	1.08	1.27	0.01	UG/L	0	Weekly	Comp
	PERMIT REQUIREMENT	*****	*****	****	18 ug/l	Monitor & Report	0.22 lbs/day				
pH Effluent	SAMPLE MEASUREMENT	*****	*****	****	6.8	6.90	*****	SU	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	6.5 Minimum	9.0 Maximum	*****				
Hexavalent Chormium Influent	SAMPLE MEASUREMENT	*****	*****	****	0.008	0.014	0.094	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER Susan Crowley		I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.					TELEPHONE		DATE		
CEM 1428. exp 3-8-13 TYPED OR PRINTED							SIGNATURE OF PRICIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT <i>S.M. Crowley</i>		702 AREA CODE	651-2200 NUMBER	11 YEAR

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)

A CBOD sample was collected and shipped to the contract lab on 2-2-2011. The at the contract lab the sample's dilution water was contaminated, There were no reliable results to report for this sample. Please see report # 354871

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

**DISCHARGE MONITORING REPORT (DMR)**

PERMITTEE NAME/ADDRESS

Name: Nevada Environmental Response Trust

Address: CO Veolia Water NA

510 Fourth Street  
Henderson, NV 89015

Facility: Nevada Environmental Response Trust

Location: Henderson, NV

Attn: Susan M. Crowley

NV 0023060
<b>PERMIT NUMBER</b>

001
DISCHARGE NUMBER

MONITORING PERIOD						
YEAR	MO	DAY	TO	YEAR	MO	DAY
11	03	01		11	03	31

NO DISCHARGE   
NOTE: Read instructions before completing this form

PARAMETER		QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS			
Hexavalent Chromium Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.000	0.000	0.000	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	0.01 mg/l	Monitor & Report				
Total Chromium Influent	SAMPLE MEASUREMENT	*****	*****	****	0.042	0.053	0.487	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
Total Chromium Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.010	0.016	0.113	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	0.1 mg/l	Monitor & Report				
Total Suspended Solids Effluent	SAMPLE MEASUREMENT	*****	*****	****	9.36	21.00	107.44	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	135 mg/l	Monitor & Report	1,634 lbs/day				
Iron, Total Effluent	SAMPLE MEASUREMENT	*****	*****	****	3.33	4.40	38.30	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	10 mg/l	Monitor & Report	121.03 lbs/day				
Manganese Effluent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	5 mg/l	NA	60.52 lbs/day				
Total Phosphorus, as P Influent	SAMPLE MEASUREMENT	*****	*****	****	0.093	0.120	1.072	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>		<small>CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.</small>					TELEPHONE		DATE		
CEM 1428, exp 3-8-13 TYPED OR PRINTED							SIGNATURE OF PRICIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT <i>S.M. Crowley</i>		702 AREA CODE	592-7727 NUMBER	11 YEAR

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)  
\* This analyte is monitored quarterly. Please see the January 11 DMR for information for the 1st Q 11.

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

PERMITTEE NAME/ADDRESS

Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015  
 Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

DISCHARGE MONITORING REPORT (DMR)

NV 0023060	001
PERMIT NUMBER	DISCHARGE NUMBER

NO DISCHARGE

NOTE: Read instructions before completing this form

MONITORING PERIOD						
YEAR	MO	DAY	TO	YEAR	MO	DAY
11	03	01		11	03	31

PARAMETER		QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS			
Total Phosphorus, as P Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.280	0.430	3.206	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	20 lbs/day				
Total Ammonia, as N Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.17	0.24	1.94	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	40 lbs/day				
Attachment A Effluent	SAMPLE MEASUREMENT	*****	*****	****	Please see attached results				0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
Color Influent	SAMPLE MEASUREMENT	*****	*****	****	38	50	*****	ACU	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	*****				
Color Effluent	SAMPLE MEASUREMENT	*****	*****	****	22.50	30.00	*****	ACU	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	*****				
Total Inorganic Nitrogen, as N Influent	SAMPLE MEASUREMENT	*****	*****	****	14.75	17.00	169.85	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
Total Inorganic Nitrogen, as N Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.22	0.24	2.48	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER Susan Crowley CEM 1428. exp 3-8-13 TYPED OR PRINTED	I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.							TELEPHONE	DATE		
	SIGNATURE OF PRICIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT							702 AREA CODE	592-7727 NUMBER	11 YEAR	05 MONTH

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS

Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015

Facility: Nevada Environmental Response Trust

Location: Henderson, NV

Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

NV 0023060  
 PERMIT NUMBER

001  
 DISCHARGE NUMBER

MONITORING PERIOD						
YEAR	MO	DAY	TO	YEAR	MO	DAY
11	03	01		11	03	31

NO DISCHARGE

NOTE: Read instructions before completing this form

PARAMETER		QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS			
Sulfate Influent	SAMPLE MEASUREMENT	*****	*****	****	1,500	*****	17,160	MG/L	0	Monthly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Sulfate Effluent	SAMPLE MEASUREMENT	*****	*****	****	1,400	*****	16,016	MG/L	0	Monthly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Total Dissolved Solids Influent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Total Dissolved Solids Effluent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Sulfide Influent	SAMPLE MEASUREMENT	*****	*****	****	0.01	*****	0.13	MG/L	0	Monthly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Sulfide Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.02	*****	0.27	MG/L	0	Monthly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Oil & Grease Influent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER  
**Susan Crowley**  
 CEM 1428, exp 3-8-13  
 TYPED OR PRINTED

I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

*S.M. Crowley*  
 SIGNATURE OF PRICIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT

TELEPHONE		DATE		
702	592-7727	11	05	24
AREA CODE	NUMBER	YEAR	MONTH	DAY

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)  
 \* This analyte is monitored quarterly. Please see the January 11 DMR for information for the 1st Q 11.



NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

PERMITTEE NAME/ADDRESS

Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015  
 Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

DISCHARGE MONITORING REPORT (DMR)

NV 0023060	001
PERMIT NUMBER	DISCHARGE NUMBER

MONITORING PERIOD

YEAR	MO	DAY	TO	YEAR	MO	DAY
11	03	01		11	03	31

NO DISCHARGE

NOTE: Read instructions before completing this form

PARAMETER		QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS			
Oil & Grease Effluent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Boron Effluent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Dissolved Oxygen Effluent	SAMPLE MEASUREMENT	*****	*****	****	6.73	7.67	78.39	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
Nitrate as N Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.13	*****	1.52	MG/L	0	Monthly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
Kjeldahl Nitrogen as N Influent	SAMPLE MEASUREMENT	*****	*****	****	3.98	6.10	45.71	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
Kjeldahl Nitrogen as N Effluent	SAMPLE MEASUREMENT	*****	*****	****	2.58	4.70	29.50	MG/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	Monitor & Report				
Chloride Influent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER  
**Susan Crowley**  
 CEM 1428, exp 3-8-13  
 TYPED OR PRINTED

CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

*S.M. Crowley*  
 SIGNATURE OF PRICIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT

TELEPHONE		DATE		
702	592-7727	11	05	24
AREA CODE	NUMBER	YEAR	MONTH	DAY

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)  
 \* This analyte is monitored quarterly. Please see the January 11 DMR for information for the 1st Q 11.

PERMITTEE NAME/ADDRESS

Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015  
 Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

NV 0023060  
 PERMIT NUMBER

001  
 DISCHARGE NUMBER

MONITORING PERIOD						
YEAR	MO	DAY	TO	YEAR	MO	DAY
11	03	01		11	03	31

NO DISCHARGE   
 NOTE: Read instructions before completing this form

PARAMETER		QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS			
Chloride Effluent	SAMPLE MEASUREMENT	*****	*****	****	*	*****	*	MG/L	0	Quarterly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
					1.34	1.80	*****	pCi/L	0	Weekly	Discrete
Radium 226 + 228 Effluent	SAMPLE MEASUREMENT	*****	*****	****	13.58	15.20	*****	pCi/L	0	Weekly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	Monitor & Report	*****				
					225	*****	2,593	MG/L	0	Monthly	Discrete
Gross Alpha Effluent	SAMPLE MEASUREMENT	*****	*****	****	0.00	*****	0.04	MG/L	0	Monthly	Discrete
	PERMIT REQUIREMENT	*****	*****	****	Monitor & Report	*****	Monitor & Report				
									0		
Chlorate Influent	SAMPLE MEASUREMENT	*****	*****	****							
	PERMIT REQUIREMENT	*****	*****	****							
Chlorate Effluent	SAMPLE MEASUREMENT	*****	*****	****							
	PERMIT REQUIREMENT	*****	*****	****							
	SAMPLE MEASUREMENT	*****	*****	****							
	PERMIT REQUIREMENT	*****	*****	****							
	SAMPLE MEASUREMENT	*****	*****	****							
	PERMIT REQUIREMENT	*****	*****	****							

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER  
 Susan Crowley  
 CEM 1428, exp 3-8-13  
 TYPED OR PRINTED

I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.


*S.M. Crowley*  
 SIGNATURE OF PRICIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT

TELEPHONE		DATE		
702	592-7727	11	05	24
AREA CODE	NUMBER	YEAR	MONTH	DAY

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)  
 \* This analyte is monitored quarterly. Please see the January 11 DMR for information for the 1st Q 11.

## ATTACHMENT 2

### Supporting Analytical Reports

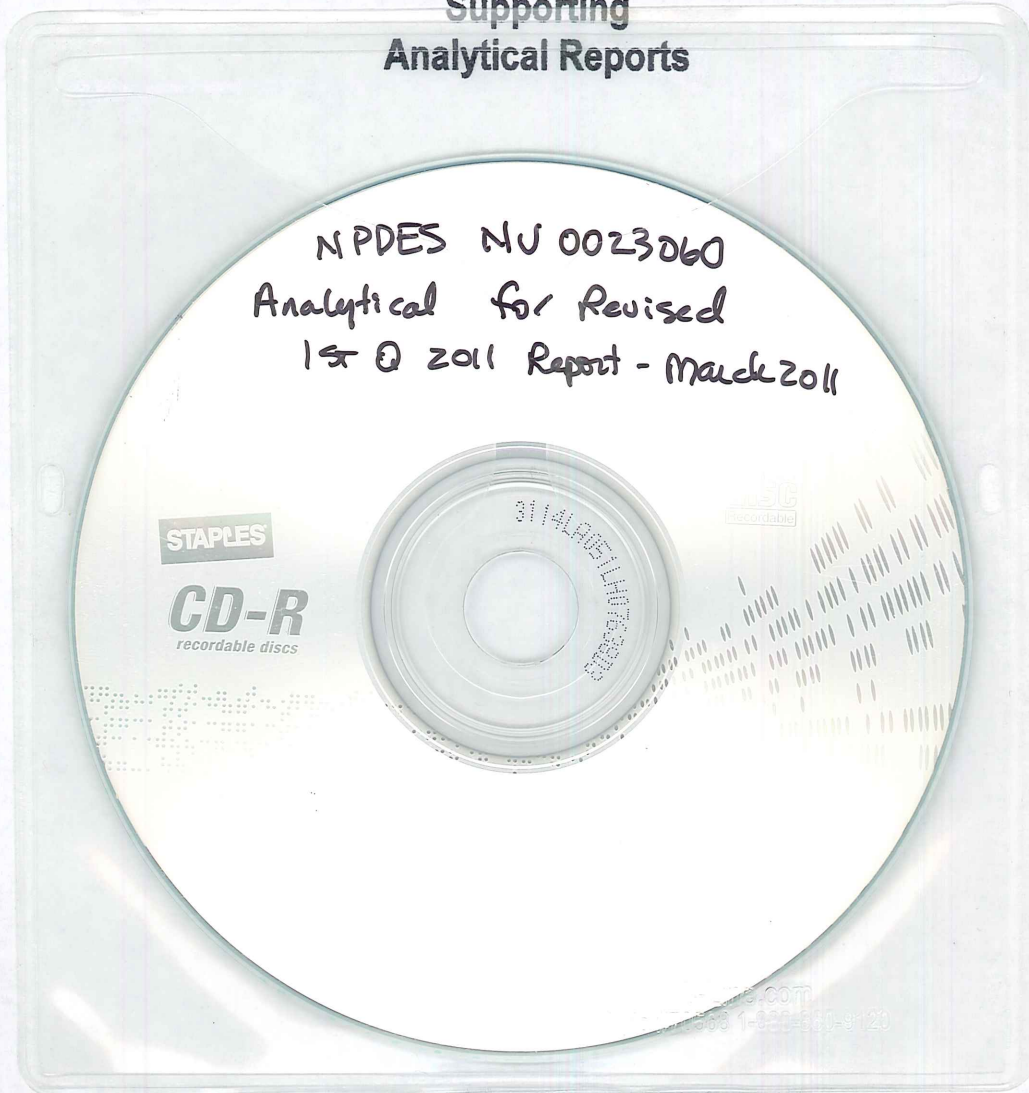

I hereby certify that all laboratory analytical data was generated by a laboratory certified by the NDEP for each constituent and media presented herein, exceptions and corresponding justifications are provided below.

*Susan M. Crowley* 05-24-11

Susan M. Crowley, CEM 1428, exp 3-8-13