



July 26, 2012

NPDES Compliance Coordinator  
Nevada Division of Environmental Protection  
Bureau of Water Pollution Control  
901 South Stewart Street, Suite 4001  
Carson City, Nevada 89701-5249

Dear NPDES Compliance Coordinator:

**Subject: NPDES Permit NV0023060 – Discharge Monitoring Reports – 2<sup>nd</sup> Quarter 2012**

The Nevada Environmental Response Trust (NERT) maintains NPDES Permit NV0023060 for discharge of treated water, as part of their on-going effort to capture and treat groundwater containing perchlorate in the Henderson area. The attached Discharge Monitoring Reports (DMRs) (Attachment 1) reflect information associated with the remediation efforts, i.e. surface discharge of treated water near the Las Vegas Wash. Included with this correspondence are the April, May, and June 2012 DMRs. Analytical summaries are included in Attachment 2, with the supporting analytical reports supplied in electronic format on a CD included in Attachment 3.

During the reporting period, the biological perchlorate remediation process continued to demonstrate compliance with the monthly average perchlorate concentration limitation of 18 µg/L (ppb). Please note that analyses of “Attachment A” analytes, for the treated discharge, continue to indicate that there is no significant increase in “other constituents” due to the treatment for perchlorate reduction.

Per the permit, daily discrete samples of the influent and effluent are collected and composited weekly for perchlorate analysis. NERT has one discrepancy to note during this reporting period. Please note that both the influent and effluent composite samples for the week dated June 23, did not include a sample from June 19, due to an error made during collection of the samples on that day. The composite samples for the week dated June 23 included the other six days of the week and perchlorate was not detected in the effluent composite sample. There is no indication that the perchlorate treatment system was operating abnormally on June 19.

Listed separately are analytical results for four Las Vegas Wash locations, one of which is required for evaluation of the permit’s authorized mixing zone (please see the information related to the LVW 5.5 control point), as well as the upgradient on-site groundwater well. Please note the wash location LVW 5.5 was within Table I.2 limits for total dissolved solids (TDS) and total inorganic nitrogen (TIN). Analytical summaries are included in Attachment 2 for your convenience in reviewing the information, with supporting analytical reports provided in electronic format on a CD included in Attachment 3.

During the reporting period, there was no activity regarding permit condition I.A.3.d.ii.

As required by permit condition I.A.20, a report describing the biological process generated solid waste is included as Attachment 4.

Should you have any questions concerning this report, please contact Kimberly Kuwabara at (510 420-2525 or [kkuwabara@environcorp.com](mailto:kkuwabara@environcorp.com) or Susan Crowley at (702) 592-7727 or [smcrowley@cox.net](mailto:smcrowley@cox.net). Thank you.

Sincerely,



Allan J. DeLorme, P.E.  
Managing Principal

Overnight Mail  
Attachments

cc: Please see attached distribution sheet



Distribution for DMRs  
- 7-16-12.xls

## NERT Document Distribution List

Document Name:

NPDES Quarterly DMR Report (e-copies provided via e-mail distribution)

Updated: 16-Jul-12

Name (Last, First)	Firm	Hard	e-Copy	Distribution Cvr Only
Land King Najima Lovato Sous Timney Palm Harbour Black Hackenberry Copeland Gratson Otani-Fehling	NDEP NDEP NDEP NDEP NDEP NDEP NDEP NDEP Neptune Hackenberry	X	X X X	
Pohlmann  Mulroy Goff Liesing  Kaplan	Brenda  COH  Pat Mike Joe  Mitch			
				SNWA SNWA SNWA  EPA, Reg 9
				NDEP DAQEM CCDAQEM Library

Name (Last, First)	Firm	Hard	e-Copy	Distribution Cvr Only
Paque Stater	Matt Rick			Tronox Counsel Tronox
Crowley Krish	Susan Ed			Crowley Environmental EJKrish
Steinberg Delorme Travers	Andrew Allan Mark			Trust Environ Environ
Schmidt-Kuwabara Singhal Pekala Ritchie	Kimberly Alka John Chris			Environ Environ Environ Environ
Kubacki Speckin Brown	Steve Russell Michele			Veolia Veolia Veolia
Stowers Sahu Crouse Erickson Kelly	Kirk Rahnjit George Lee Joe			Broadbent BMI Syngenta Stauffer Montrose
	Sundberg Gibson			Montrose AmPac
	Richards Bellotti Wilkinson Mack			Olin Olin Timet
				Montrose Counsel

NPDES Permit NV0023060 – 2<sup>nd</sup> Q 2012 DMR  
CEM Certification

I hereby certify that I am responsible for the services described in this document and for the preparation of this document. The services described in this document have been provided in a manner consistent with the current standards of the profession and, to the best of my knowledge, comply with all applicable federal, state and local statutes, regulations and ordinances.

S. Crowley

7-20-12

Susan Crowley  
CEM 1428, expires 3-8-13

## **ATTACHMENT 1**

### **Discharge Monitoring Reports (DMR)**



12 April DMR.xls

**April 2012**



12 May DMR.xls

**May 2012**



12 June DMR.xls

**June 2012**

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA

510 Fourth Street  
 Henderson, NV, 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
001	DISCHARGE NUMBER
NV 0023060	PERMIT NUMBER

NOTE: Read instructions before completing this form  
 NO DISCHARGE \_\_\_\_\_


MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
FROM 12	04	01	TO 12	04	30

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Flow	SAMPLE	1.29	M/GD	*****	*****	*****	0	Cont	Flow Meter
Effluent	MEASUREMENT	1.45 MGD	Maximum	*****	*****	*****	0	Weekly	Discrete
BOD5 (Inhibited)	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	0	Weekly	Discrete
Influent	MEASUREMENT	SAMPLE	PERMIT REQUIREMENT	*****	*****	*****	0	Weekly	Discrete
BOD5 (Inhibited)	MEASUREMENT	SAMPLE	PERMIT REQUIREMENT	*****	*****	*****	0	Weekly	Discrete
Effluent	PERCHLORATE FBR	MEASUREMENT	SAMPLE	PERMIT REQUIREMENT	*****	*****	0	Weekly	Comp
Influent	PERCHLORATE FBR	MEASUREMENT	SAMPLE	PERMIT REQUIREMENT	*****	*****	0	Weekly	Comp
Effluent	pH	MEASUREMENT	SAMPLE	PERMIT REQUIREMENT	*****	*****	0	Weekly	Discrete
Effluent	Hexavalent Chromium	MEASUREMENT	SAMPLE	PERMIT REQUIREMENT	*****	*****	0	Weekly	Discrete
Influent	MEASUREMENT	SAMPLE	PERMIT REQUIREMENT	*****	*****	*****	0	Weekly	Discrete

I CERTIFY UNDER PENALTY OF PERJURY THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON ANY INJURY OF THE PERSON OR PERSONS WHO DAMAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER  
**Susan Crowley**  
 CEM 1428 exp 3-8-13  
 TYPED OR PRINTED

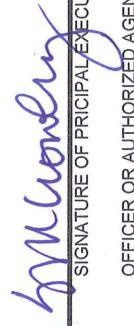SIGNATURE OF PRINCIPAL EXECUTIVE  
  
 OFFICER OR AUTHORIZED AGENT

TELEPHONE \_\_\_\_\_ DATE \_\_\_\_\_  
 702 AREA CODE \_\_\_\_\_ 592-7727 NUMBER \_\_\_\_\_ 2012 JULY 16 DAY

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA

510 Fourth Street  
 Henderson, NV, 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
NV 0023050	001
DISCHARGE NUMBER	
PERMIT NUMBER	

MONITORING PERIOD

YEAR	MO	DAY	YEAR	MO	DAY
FROM	12	04	TO	12	04

PARAMETER	QUANTITY OR LOAD/ING						QUALITY OR CONCENTRATION						NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE		
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS	M/G/L	0	Weekly	Discrete						
Hexavalent Chromium	SAMPLE	*****	*****	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0	Weekly	Discrete			
	MEASUREMENT	*****	*****	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000						
Effluent	PERMIT	*****	*****	0.044	0.044	0.044	0.044	0.044	0.044	0.044	0.044	0	Weekly	Discrete			
	REQUIREMENT	*****	*****	0.044	0.044	0.044	0.044	0.044	0.044	0.044	0.044						
Total Chromium	SAMPLE	*****	*****	0.058	0.058	0.058	0.058	0.058	0.058	0.058	0.058	0	Weekly	Discrete			
	MEASUREMENT	*****	*****	0.058	0.058	0.058	0.058	0.058	0.058	0.058	0.058						
Influent	PERMIT	*****	*****	0.006	0.006	0.006	0.006	0.006	0.006	0.006	0.006	0	Weekly	Discrete			
	REQUIREMENT	*****	*****	0.006	0.006	0.006	0.006	0.006	0.006	0.006	0.006						
Total Suspended Solids	SAMPLE	*****	*****	0.008	0.008	0.008	0.008	0.008	0.008	0.008	0.008	0	Weekly	Discrete			
	MEASUREMENT	*****	*****	0.008	0.008	0.008	0.008	0.008	0.008	0.008	0.008						
Effluent	PERMIT	*****	*****	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0	Weekly	Discrete			
	REQUIREMENT	*****	*****	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l	0.1 mg/l						
Iron, Total	SAMPLE	*****	*****	1.98	1.98	1.98	1.98	1.98	1.98	1.98	1.98	0	Weekly	Discrete			
	MEASUREMENT	*****	*****	1.98	1.98	1.98	1.98	1.98	1.98	1.98	1.98						
Effluent	PERMIT	*****	*****	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l	0	Weekly	Discrete			
	REQUIREMENT	*****	*****	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l	10 mg/l						
Manganese	SAMPLE	*****	*****	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0	Quarterly	Discrete			
	MEASUREMENT	*****	*****	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62						
Effluent	PERMIT	*****	*****	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l	0	Quarterly	Discrete			
	REQUIREMENT	*****	*****	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l	5 mg/l						
Total Phosphorus, as P	SAMPLE	*****	*****	0.017	0.017	0.017	0.017	0.017	0.017	0.017	0.017	0	Weekly	Discrete			
	MEASUREMENT	*****	*****	0.017	0.017	0.017	0.017	0.017	0.017	0.017	0.017						
Influent	PERMIT	*****	*****	0.034	0.034	0.034	0.034	0.034	0.034	0.034	0.034	0	Weekly	Discrete			
	REQUIREMENT	*****	*****	0.034	0.034	0.034	0.034	0.034	0.034	0.034	0.034						
I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.																	
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>																	
CEM 1428, exp 3-8-13 TYPED OR PRINTED																	
SIGNATURE OF PRINCIPAL EXECUTIVE 																	
702 AREA CODE 592-7727 NUMBER																	
COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)																	
DATE																	
July 16, 2012																	
MONTH DAY																	

NO DISCHARGE

NOTE: Read instructions before completing this form

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV, 89015

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
PERMIT NUMBER	001
DISCHARGE NUMBER	

NO DISCHARGE

NOTE: Read instructions before completing this form

MONITORING PERIOD									
	YEAR	MO	DAY	YEAR	MO	DAY			
	FROM	12	04	01	TO	12	04	30	

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Effluent	SAMPLE	*****	*****	0.164	0.260	1.786	M/G/L	0	Weekly
	MEASUREMENT	*****	*****						Discrete
Effluent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Effluent	SAMPLE	*****	*****						
	MEASUREMENT	*****	*****						
Effluent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Attachment A	SAMPLE	*****	*****						
	MEASUREMENT	*****	*****						
Effluent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Color	SAMPLE	*****	*****						
	MEASUREMENT	*****	*****						
Influent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Color	SAMPLE	*****	*****						
	MEASUREMENT	*****	*****						
Effluent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Effluent	SAMPLE	*****	*****						
	MEASUREMENT	*****	*****						
Influent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Total Inorganic Nitrogen, as N	SAMPLE	*****	*****						
	MEASUREMENT	*****	*****						
Influent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Total Inorganic Nitrogen, as N	SAMPLE	*****	*****						
	MEASUREMENT	*****	*****						
Effluent	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						

I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

*Susan Crowley*  **NAME/TITLE PRINCIPAL EXECUTIVE OFFICER**  
**Susan Crowley**  
**CEM 1428, exp 3-8-13**  
**TYPED OR PRINTED**

**OFFICER OR AUTHORIZED AGENT**

*John Wenzel*  **SIGNATURE OF PRINCIPAL EXECUTIVE**  
**702 592-7727**  
**AREA NUMBER**  
**CODE**

PAGE 3 OF 6

00044/961223-1801

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA

510 Fourth Street  
 Henderson, NV, 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV

Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
001	DISCHARGE NUMBER
NV 0023030	PERMIT NUMBER

MONITORING PERIOD					
YEAR 12	MO 04	DAY 01	YEAR 12	MO 04	DAY 30
FROM	TO				

PARAMETER	QUANTITY OR LOAD/ING						QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS					
Sulfate	SAMPLE	*****	*****	1,450	*****	15,988	MG/L	0	Monthly			Discrete
	MEASUREMENT	*****	****									
	PERMIT	*****	*****									
Influent	REQUIREMENT	*****	*****									
Sulfate	SAMPLE	*****	*****									
	MEASUREMENT	*****	****									
	PERMIT	*****	*****									
Effluent	REQUIREMENT	*****	*****									
Total Dissolved Solids	SAMPLE	*****	*****									
	MEASUREMENT	*****	****									
	PERMIT	*****	*****									
Influent	REQUIREMENT	*****	*****									
Total Dissolved Solids	SAMPLE	*****	*****									
	MEASUREMENT	*****	****									
	PERMIT	*****	*****									
Effluent	REQUIREMENT	*****	*****									
Sulfide	SAMPLE	*****	*****									
	MEASUREMENT	*****	****									
	PERMIT	*****	*****									
Influent	REQUIREMENT	*****	*****									
Sulfide	SAMPLE	*****	*****									
	MEASUREMENT	*****	****									
	PERMIT	*****	*****									
Effluent	REQUIREMENT	*****	*****									
Oil & Grease	SAMPLE	*****	*****									
	MEASUREMENT	*****	****									
	PERMIT	*****	*****									
Influent	REQUIREMENT	*****	*****									

COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)

INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>	TELEPHONE	DATE
CEM 1428, exp 3-8-13 TYPED OR PRINTED	702 592-7727 NUMBER	2012 JULY YEAR MONTH DAY
SIGNATURE OF PRINCIPAL EXECUTIVE 	AREA CODE	
OFFICER OR AUTHORIZED AGENT		

NOTE: Read instructions before completing this form  
 NO DISCHARGE

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA

510 Fourth Street  
 Henderson, NV, 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV

Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
001	DISCHARGE NUMBER
NV 0023060	PERMIT NUMBER

MONITORING PERIOD					
YEAR FROM 12	MO 04	DAY 01	TO 12	MO 04	DAY 30

NOTE: Read instructions before completing this form

NO DISCHARGE

PARAMETER		QUANTITY OR LOAD/ING	QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
			30 Day Ave	7 Day Average	UNITS			
Oil & Grease	SAMPLE	*****	1.70	*****	MG/L	0	Quarterly	Discrete
	MEASUREMENT	*****						
	PERMIT	*****						
Effluent	REQUIREMENT	*****						
Boron	SAMPLE	*****						
	MEASUREMENT	*****						
	PERMIT	*****						
Effluent	REQUIREMENT	*****						
Dissolved Oxygen	SAMPLE	*****						
	MEASUREMENT	*****						
	PERMIT	*****						
Effluent	REQUIREMENT	*****						
Nitrate as N	SAMPLE	*****						
	MEASUREMENT	*****						
	PERMIT	*****						
Effluent	REQUIREMENT	*****						
Kjeldahl Nitrogen as N	SAMPLE	*****						
	MEASUREMENT	*****						
	PERMIT	*****						
Influent	REQUIREMENT	*****						
Kjeldahl Nitrogen as N	SAMPLE	*****						
	MEASUREMENT	*****						
	PERMIT	*****						
Effluent	REQUIREMENT	*****						
Chloride	SAMPLE	*****						
	MEASUREMENT	*****						
	PERMIT	*****						
Influent	REQUIREMENT	*****						
CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.								
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b> <b>CEM 1428, exp 3-8-13</b>			TELEPHONE			DATE		
TYPED OR PRINTED			702	592-7727	2012	July	16	
SIGNATURE OF PRINCIPAL EXECUTIVE  <b>Susan Crowley</b>			AREA CODE	NUMBER	YEAR	MONTH	DAY	
COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)								

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015  
 Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
DISCHARGE NUMBER	001
PERMIT NUMBER	

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
FROM 12	04	01	TO 12	04	30

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Aver(lbs/day)			
Chloride	SAMPLE	*****	***	1,700	*****	18,459	MG/L	0	Quarterly
Effluent	MEASUREMENT	*****	***						Discrete
	PERMIT	*****	***						
	REQUIREMENT	*****	***						
Chlorate	SAMPLE	*****	***						
Effluent	MEASUREMENT	*****	***						
	PERMIT	*****	***						
	REQUIREMENT	*****	***						
Chlorate	SAMPLE	*****	***						
Effluent	MEASUREMENT	*****	***						
	PERMIT	*****	***						
	REQUIREMENT	*****	***						
	SAMPLE	*****	***						
	MEASUREMENT	*****	***						
	PERMIT	*****	***						
	REQUIREMENT	*****	***						
	SAMPLE	*****	***						
	MEASUREMENT	*****	***						
	PERMIT	*****	***						
	REQUIREMENT	*****	***						
	SAMPLE	*****	***						
	MEASUREMENT	*****	***						
	PERMIT	*****	***						
	REQUIREMENT	*****	***						
	SAMPLE	*****	***						
	MEASUREMENT	*****	***						
	PERMIT	*****	***						
	REQUIREMENT	*****	***						

I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH THE SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>	TELEPHONE	DATE
CEM 1428, exp 3-8-13 TYPED OR PRINTED	702 592-7727	2012 July 16
OFFICER OR AUTHORIZED AGENT	NUMBER	MONTH
AREA CODE	YEAR	DAY

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV. 89015

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)  
**DISCHARGE MONITORING REPORT (DMR)**  
 NV 0025060  
**PERMIT NUMBER** 001  
**DISCHARGE NUMBER**

NOTE: Read instructions before completing this form  
 NO DISCHARGE  
 MONITORING PERIOD

FROM 12 TO 01     DAY 05     MO 01     YEAR 12     DAY 31

PARAMETER			QUANTITY OR LOADING		QUALITY OR CONCENTRATION		NO. EX		FREQUENCY OF ANALYSIS		SAMPLE TYPE
Flow	SAMPLE	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS	*****	*****	
Effluent	MEASUREMENT	1.28	1.29	MGD	*****	*****	*****	*****	*****	*****	
BOD5 (Inhibited)	PERMIT REQUIREMENT	1.45 MGD Maximum	1.75 MGD Maximum		*****	*****	*****	*****	*****	*****	
Influent	MEASUREMENT	*****	*****	****	****	****	****	****	****	****	
BOD5 (Inhibited)	PERMIT REQUIREMENT	*****	*****	****	****	****	****	****	****	****	
Effluent	MEASUREMENT	*****	*****	****	****	****	****	****	****	****	
Perchlorate FBR	MEASUREMENT	*****	*****	****	****	****	****	****	****	****	
Influent	PERMIT REQUIREMENT	*****	*****	****	****	****	****	****	****	****	
Perchlorate FBR	MEASUREMENT	*****	*****	****	****	****	****	****	****	****	
Effluent	PERMIT REQUIREMENT	*****	*****	****	****	****	****	****	****	****	
pH	MEASUREMENT	*****	*****	****	****	****	****	****	****	****	
Effluent	PERMIT REQUIREMENT	*****	*****	****	****	****	****	****	****	****	
Hexavalent Chromium	MEASUREMENT	*****	*****	****	****	****	****	****	****	****	
Influent	PERMIT REQUIREMENT	*****	*****	****	****	****	****	****	****	****	

I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

*Susan Crowley*  
 NAME/TITLE PRINCIPAL EXECUTIVE OFFICER  
 Susan Crowley  
 CEM 1428 exp 3-8-13  
 TYPED OR PRINTED

702 AREA	592-7727 NUMBER	2012 YEAR	July MONTH	16 DAY
CODE				

OFFICER OR AUTHORIZED AGENT

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street

Henderson, NV, 89015  
 Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV

Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

**DISCHARGE MONITORING REPORT (DMR)**

PERMIT NUMBER	001
DISCHARGE NUMBER	

**MONITORING PERIOD**

YEAR	MO	DAY	YEAR	MO	DAY
12	05	01	12	05	31

PARAMETER		QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Hexavalent Chromium	SAMPLE	*****	*****	*****	0.000	0.000	0.000	0	Weekly	Discrete
Effluent	MEASUREMENT	*****	*****	*****	Monitor & Report	0.01 mg/l	Monitor & Report			
Total Chromium	PERMIT REQUIREMENT	*****	*****	*****	0.042	0.056	0.566	0	Weekly	Discrete
Influent	SAMPLE	*****	*****	*****	Monitor & Report	Monitor & Report	Monitor & Report			
Total Chromium	MEASUREMENT	*****	*****	*****	0.008	0.009	0.077	0	Weekly	Discrete
Effluent	PREMIT REQUIREMENT	*****	*****	*****	Monitor & Report	0.1 mg/l	Monitor & Report			
Total Suspended Solids	SAMPLE	*****	*****	*****	14.50	17.00	148.45	0	Weekly	Discrete
Effluent	MEASUREMENT	*****	*****	*****	135 mg/l	Monitor & Report	1,634 lbs/day			
Iron, Total	PERMIT REQUIREMENT	*****	*****	*****	2.93	3.40	28.04	0	Weekly	Discrete
Manganese	SAMPLE	*****	*****	*****	10 mg/l	Monitor & Report	121.03 lbs/day			
Effluent	MEASUREMENT	*****	*****	*****	5 mg/l	NA	60.52 lbs/day			
Total Phosphorus, as P	PERMIT REQUIREMENT	*****	*****	*****	0.019	0.053	0.107	0	Quarterly	Discrete
Influent	SAMPLE	*****	*****	*****	Monitor & Report	Monitor & Report	Monitor & Report			
	MEASUREMENT	*****	*****	*****					TELEPHONE	DATE
	PERMIT REQUIREMENT	*****	*****	*****						
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	Susan Crowley									
CEM 1428, exp 3-8-13	TYPED OR PRINTED									
COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)										
* Monitoring frequency is quarterly Please See April 2012 DMR for analyte information.										

CERTIFY UNDER PENALTY OF PERJURY THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

00044/961223-1801

PAGE 2 OF 6

00044/961223-1801

NOTE: Read instructions before completing this form

NO DISCHARGE

*Susan Crowley*  
 SIGNATURE OF PRINCIPAL EXECUTIVE  
 OFFICER OR AUTHORIZED AGENT  
 AREA CODE

702 592-7727  
 NUMBER  
 MONTH  
 DAY

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: C/O Veolia Water NA

510 Fourth Street  
 Henderson, NV 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

DISCHARGE MONITORING REPORT (DMR)	
NV 0023060	001
DISCHARGE NUMBER	
PERMIT NUMBER	

MONITORING PERIOD			
YEAR	MO	DAY	YEAR
FROM 12	05	01	TO 12
			05
			31

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Total Phosphorus, as P	SAMPLE	*****	*****	0.200	0.340	1.494	MG/L	0	Weekly
Effluent	MEASUREMENT	*****	****						Discrete
	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Total Ammonia, as N	SAMPLE	*****	*****						
Effluent	MEASUREMENT	*****	****						Discrete
	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Attachment A	SAMPLE	*****	*****						
Effluent	MEASUREMENT	*****	****						Discrete
	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Color	SAMPLE	*****	*****						
Influent	MEASUREMENT	*****	****						Discrete
	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Color	SAMPLE	*****	*****						
Effluent	MEASUREMENT	*****	****						Discrete
	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Total Inorganic Nitrogen, as N	SAMPLE	*****	*****						
Effluent	MEASUREMENT	*****	****						Discrete
	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
Total Inorganic Nitrogen, as N	SAMPLE	*****	*****						
Effluent	MEASUREMENT	*****	****						Discrete
	PERMIT	*****	*****						
	REQUIREMENT	*****	*****						
CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.									
COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)									
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>		SIGNATURE OF PRINCIPAL EXECUTIVE 		TELEPHONE		DATE			
CEM 1428, exp 3-8-13 TYPED OR PRINTED		702 AREA NUMBER <b>702</b>		592-7727 YEAR <b>2012</b>		July <b>16</b> DAY			

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
DISCHARGE NUMBER	001
PERMIT NUMBER	

MONITORING PERIOD			
YEAR FROM 12	MO 05	DAY 01	YEAR TO 12
MO 05	DAY 05	DAY 31	

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE								
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	*****											
Sulfate	SAMPLE	*****	*****	1,500	*****	16,008	M/G/L	0	Monthly								
Influent	MEASUREMENT	*****	****	*****	*****	*****	*****	*****	Discrete								
	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****									
Sulfate	SAMPLE	*****	*****	1,400	*****	14,941	M/G/L	0	Monthly								
Effluent	MEASUREMENT	*****	****	*****	*****	*****	*****	*****	Discrete								
	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****									
Total Dissolved Solids	SAMPLE	*****	*****	*	*****	*	*****	*****	Quarterly								
Influent	MEASUREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****	Discrete								
	PREMIT REQUIREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****									
Total Dissolved Solids	SAMPLE	*****	*****	*	*****	*	*****	*****	Quarterly								
Effluent	MEASUREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****	Discrete								
	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****									
Sulfide	SAMPLE	*****	*****	0.01	*****	0.13	M/G/L	0	Monthly								
Influent	MEASUREMENT	*****	****	*****	*****	*****	*****	*****	Discrete								
	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****									
Sulfide	SAMPLE	*****	*****	0.01	*****	0.13	M/G/L	0	Monthly								
Effluent	MEASUREMENT	*****	****	*****	*****	*****	*****	*****	Discrete								
	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****									
Oil & Grease	SAMPLE	*****	*****	*	*****	*	*****	*****	Quarterly								
Influent	MEASUREMENT	*****	****	*****	*****	*****	*****	*****	Discrete								
	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	Monitor & Report	*****									
CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREFERRED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.																	
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER		<i>Susan Crowley</i>		TELEPHONE		DATE											
CEM 1428, exp 3-8-13		SIGNATURE OF PRINCIPAL EXECUTIVE		702 592-7727		2012											
TYPED OR PRINTED		AREA		NUMBER		MONTH		YEAR									
COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here) * Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.																	
OFFICER OR AUTHORIZED AGENT																	

COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)  
 \* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.

00044/961223-1801

PAGE 4 OF 6

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA

510 Fourth Street  
 Henderson, NV 89015  
 Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

**DISCHARGE MONITORING REPORT (DMR)**

PERMIT NUMBER	001
DISCHARGE NUMBER	

<b>MONITORING PERIOD</b>			
FROM	YEAR 12	MO 05	DAY 01
TO	YEAR 12	MO 05	DAY 31

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX.	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Oil & Grease	SAMPLE	*****	****	*	*****	*		Quarterly	Discrete
Effluent	MEASUREMENT	*****	****	Monitor & Report	*****	Monitor & Report	0	Quarterly	
Boron	PERMIT REQUIREMENT	*****	****	*	*****	*			
Effluent	SAMPLE	*****	****	Monitor & Report	*****	Monitor & Report	0	Quarterly	Discrete
Dissolved Oxygen	MEASUREMENT	*****	****	Monitor & Report	*****	Monitor & Report	0	Weekly	Discrete
Effluent	PERMIT REQUIREMENT	*****	****	6.16	7.40	66.21	MG/L	0	
Nitrate as N	SAMPLE	*****	****	Monitor & Report	*****	Monitor & Report	0	Monthly	Discrete
Effluent	MEASUREMENT	*****	****	0.41	*****	4.29	MG/L	0	
Kjeldahl Nitrogen as N	PERMIT REQUIREMENT	*****	****	Monitor & Report	*****	Monitor & Report			
Influent	SAMPLE	*****	****	0.10	0.26	0.23	MG/L	0	Weekly
	MEASUREMENT	*****	****	Monitor & Report	*****	Monitor & Report			Discrete
	PERMIT REQUIREMENT	*****	****	Monitor & Report	*****	Monitor & Report			
Kjeldahl Nitrogen as N	SAMPLE	*****	****	2.94	7.00	7.68	MG/L	0	Weekly
Effluent	MEASUREMENT	*****	****	Monitor & Report	*****	Monitor & Report			Discrete
Chloride	PERMIT REQUIREMENT	*****	****	*	*****	*	MG/L	0	Quarterly
Influent	SAMPLE	*****	****	Monitor & Report	*****	Monitor & Report			
	MEASUREMENT	*****	****	Monitor & Report	*****	Monitor & Report			
	PERMIT REQUIREMENT	*****	****	Monitor & Report	*****	Monitor & Report			
	COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)						TELEPHONE	DATE	
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>	CEM 1428, exp 3-8-13	TYPED OR PRINTED					702-7727	2012	July
							NUMBER	MONTH	DAY
							AREA CODE		

\* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.

00044961223-1801

PAGE 5 OF 6

NOTE: Read instructions before completing this form

NO DISCHARGE

*Susan Crowley*  
 SIGNATURE OF PRINCIPAL EXECUTIVE  
 OFFICER OR AUTHORIZED AGENT

INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION.

PARTICIPANT NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV, 89015

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)			
DISCHARGE MONITORING REPORT (DMR)			
DISCHARGE NUMBER	001	DISCHARGE NUMBER	
PERMIT NUMBER	NV 0023060	PERMIT NUMBER	

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

MONITORING PERIOD  
 YEAR    MO    DAY              YEAR    MO    DAY  
 FROM 12    05    01              TO 12    05    31

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX.	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Chloride	SAMPLE	*****		*	*****	*			
	MEASUREMENT	*****		****	*****	*****			
	PERMIT	*****			Monitor & Report	*****		Quarterly	Discrete
Effluent	REQUIREMENT	*****							
Chlorate	SAMPLE	*****		220	*****	2,331	MG/L	0	
	MEASUREMENT	*****			Monitor & Report				
Influent	PERMIT	*****			*****				
Chlorate	REQUIREMENT	*****			Monitor & Report				
	SAMPLE	*****		0.03	*****	0.27	MG/L	0	
	MEASUREMENT	*****			Monitor & Report				
Effluent	PERMIT	*****			*****				
	REQUIREMENT	*****			Monitor & Report				
	SAMPLE	*****							
	MEASUREMENT	*****							
	PERMIT	*****							
	REQUIREMENT	*****							
	SAMPLE	*****							
	MEASUREMENT	*****							
	PERMIT	*****							
	REQUIREMENT	*****							
	SAMPLE	*****							
	MEASUREMENT	*****							
	PERMIT	*****							
	REQUIREMENT	*****							

I CERTIFY UNDER PENALTY OF PERJURY THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)  
 \* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.

Susan Crowley  
 SIGNATURE OF PRINCIPAL EXECUTIVE  
 OFFICER OR AUTHORIZED AGENT

702-592-7727  
 AREA NUMBER  
 CODE

JULY  
 MONTH  
 DAY

00044961223-1801  
 DATE  
 TELEPHONE

PAGE 6 OF 6

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)
DISCHARGE NUMBER
001

MONITORING PERIOD				
YEAR	MO	DAY	YEAR	MO
12	06	01	TO	12 06 30

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX	NO. FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Flow	SAMPLE	1.28	1.33	MGD	*****	*****		0	Cont
Effluent	MEASUREMENT				*****	*****			
	PERMIT	1.45 MGD	1.75 MGD						
BOD5 (Inhibited)	REQUIREMENT	Maximum	Maximum						
Influent	MEASUREMENT	*****	*****	*****					
	PERMIT	*****	*****	*****					
BOD5 (Inhibited)	REQUIREMENT	*****	*****	*****					
Effluent	MEASUREMENT	*****	*****	*****					
	PERMIT	*****	*****	*****					
Perchlorate FBR	SAMPLE	*****	*****	*****					
Influent	MEASUREMENT	*****	*****	*****					
	PERMIT	*****	*****	*****					
Perchlorate FBR	REQUIREMENT	*****	*****	*****					
Effluent	SAMPLE	*****	*****	*****					
pH	MEASUREMENT	*****	*****	*****					
	PERMIT	*****	*****	*****					
Hexavalent Chromium	REQUIREMENT	*****	*****	*****					
Effluent	SAMPLE	*****	*****	*****					
	MEASUREMENT	*****	*****	*****					
Influent	PERMIT	*****	*****	*****					
	REQUIREMENT	*****	*****	*****					
I CERTIFY UNDER PENALTY OF PERJURY THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY OVERSIGHT AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MAINTAIN THE SYSTEM OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATORS.									
COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)									
<i>Susan Crowley</i>									
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER									
<b>Susan Crowley</b>									
CEM 1428, exp 3-8-13									
TYPED OR PRINTED									
SIGNATURE OF PRINCIPAL/EXECUTIVE									
<i>Susan Crowley</i>									
OFFICER OR AUTHORIZED AGENT									
TELEPHONE									
DATE									
702 692-7727									
702 AREA NUMBER									
7 MONTH									
20 DAY									

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV, 89015  
 Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)			
DISCHARGE MONITORING REPORT (DMR)			
NV 0023060		001	DISCHARGE NUMBER
PERMIT NUMBER			

MONITORING PERIOD			
YEAR	MO	DAY	YEAR
FROM 12	06	01	TO 12
			06 30

NOTE: Read instructions before completing this form

NO DISCHARGE

PARAMETER		QUANTITY ORLOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)			
Hexavalent Chromium	SAMPLE	*****	0.000	0.000	0.000	MG/L	0	Weekly	Discrete	
Effluent	MEASUREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
	PERMIT REQUIREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
Total Chromium	SAMPLE	*****	0.046	0.060	0.413	MG/L	0	Weekly	Discrete	
Influent	MEASUREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
	PERMIT REQUIREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
Total Chromium	SAMPLE	*****	0.009	0.011	0.101	MG/L	0	Weekly	Discrete	
Effluent	MEASUREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
	PERMIT REQUIREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
Total Suspended Solids	SAMPLE	*****	0.000	0.000	0.000	MG/L	0	Weekly	Discrete	
Effluent	MEASUREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
	PERMIT REQUIREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
Iron, Total	SAMPLE	*****	0.000	0.000	0.000	MG/L	0	Weekly	Discrete	
Effluent	MEASUREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
	PERMIT REQUIREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
Manganese	SAMPLE	*****	0.000	0.000	0.000	MG/L	0	Quarterly	Discrete	
Effluent	MEASUREMENT	*****	****	0.000	0.000	MG/L	0	Quarterly	Discrete	
	PERMIT REQUIREMENT	*****	****	0.000	0.000	MG/L	0	Quarterly	Discrete	
Total Phosphorus, as P	SAMPLE	*****	0.045	0.060	0.588	MG/L	0	Weekly	Discrete	
Effluent	MEASUREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
	PERMIT REQUIREMENT	*****	****	0.000	0.000	MG/L	0	Weekly	Discrete	
NAME/TITLE: PRINCIPAL EXECUTIVE OFFICER		I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.			DATE					
Susan Crowley CEM 1428, exp 3-8-13 TYPED OR PRINTED		<i>Susan Crowley</i> SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT			TELEPHONE					
					702	592-7727	12	7	20	
					AREA CODE	NUMBER	YEAR	MONTH	DAY	

COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)

\* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.

00044961223-1801

PAGE 2 OF 6

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Vedia Water NA

510 Fourth Street  
 Henderson, NV 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

**DISCHARGE MONITORING REPORT (DMR)**

DISCHARGE NUMBER	001
PERMIT NUMBER	

<b>MONITORING PERIOD</b>			
YEAR	MO	DAY	YEAR
12	06	01	12
FROM	TO	06	30

PARAMETER	QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX. OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)		
Total Phosphorus, as P	SAMPLE	*****	*****	0.191	0.350	2.575	MG/L	0
Effluent	MEASUREMENT	*****	****					Discrete
	PERMIT	*****	*****					
	REQUIREMENT	*****	*****					
Total Ammonia, as N	SAMPLE	*****	*****					Discrete
Effluent	MEASUREMENT	*****	****					
	PERMIT	*****	*****					
	REQUIREMENT	*****	*****					
Attachment A	SAMPLE	*****	*****					Discrete
Effluent	MEASUREMENT	*****	****					
	PERMIT	*****	*****					
	REQUIREMENT	*****	*****					
Color	SAMPLE	*****	*****					Discrete
Effluent	MEASUREMENT	*****	****					
	PERMIT	*****	*****					
	REQUIREMENT	*****	*****					
Color	SAMPLE	*****	*****					Discrete
Effluent	MEASUREMENT	*****	****					
	PERMIT	*****	*****					
	REQUIREMENT	*****	*****					
Total Inorganic Nitrogen, as N	SAMPLE	*****	*****					Discrete
Effluent	MEASUREMENT	*****	****					
	PERMIT	*****	*****					
	REQUIREMENT	*****	*****					
Total Inorganic Nitrogen, as N	SAMPLE	*****	*****					Discrete
Effluent	MEASUREMENT	*****	****					
	PERMIT	*****	*****					
	REQUIREMENT	*****	*****					
I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.								
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>				<i>Susan Crowley</i>			TELEPHONE	DATE
CEM 1428, exp 3-8-13 TYPED OR PRINTED							702 592-7727	7 20
COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)								
						NUMBER	MONTH	DAY
						AREA CODE		

00044/961223-1801

PAGE 3 OF 6

NOTE: Read instructions before completing this form

NO DISCHARGE

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA

510 Fourth Street  
 Henderson, NV 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)	
DISCHARGE MONITORING REPORT (DMR)	
NV 0023060	001
DISCHARGE NUMBER	
PERMIT NUMBER	

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
FROM	12	06	TO	12	06

PARAMETER	QUANTITY OR LOADING						QUALITY OR CONCENTRATION						NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Aver(b/day)	UNITS	MG/L	0	Monthly	Discrete				
Sulfate	SAMPLE	*****		1,400	*****		13,459	MG/L	0	Monthly	Discrete				
	MEASUREMENT	****													
Influent	PERMIT	****													
	REQUIREMENT	*****													
Sulfate	SAMPLE	*****													
	MEASUREMENT	****													
Effluent	PERMIT	*****													
	REQUIREMENT	*****													
Total Dissolved Solids	SAMPLE	*****													
	MEASUREMENT	****													
Influent	PREMIT	*****													
	REQUIREMENT	*****													
Total Dissolved Solids	SAMPLE	*****													
	MEASUREMENT	****													
Effluent	PERMIT	*****													
	REQUIREMENT	*****													
Sulfide	SAMPLE	*****													
	MEASUREMENT	****													
Influent	PERMIT	*****													
	REQUIREMENT	*****													
Sulfide	SAMPLE	*****													
	MEASUREMENT	****													
Effluent	PERMIT	*****													
	REQUIREMENT	*****													
Oil & Grease	SAMPLE	*****													
	MEASUREMENT	****													
Influent	PERMIT	*****													
	REQUIREMENT	*****													
I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON MY INJURY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.												<i>S. Crowley</i>			
COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)												<i>S. Crowley</i>			
* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.												702			
TYPED OR PRINTED												AREA NUMBER	12	7	
OFFICER OR AUTHORIZED AGENT												CODE	MONTH	DAY	

NOTE: Read instructions before completing this form

COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here)  
 \* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.

00044/961223-1801  
 00044/961223-1801

SIGNATURE OF PRINCIPAL EXECUTIVE

OFFICER OR AUTHORIZED AGENT

NUMBER

MONTH

DAY

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust:  
 Address: CO Veolia Water NA  
 510 Fourth Street  
 Henderson, NV 89015

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
NV 0023060	001
DISCHARGE NUMBER	
PERMIT NUMBER	

Facility: Nevada Environmental Response Trust:  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
FROM 12	06	01	TO 12	06	30

PARAMETER	QUANTITY ORLOADING			QUALITY OR CONCENTRATION			NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
	30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave (lbs/day)			
Oil & Grease	SAMPLE *****		*****	*	*****	*	Mg/L	0	Quarterly
Effluent	MEASUREMENT	*****	*****	*****	*****	*****	*****		Discrete
Boron	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	*****		
Effluent	MEASUREMENT	*****	*****	*****	*****	*****	*****		Discrete
Dissolved Oxygen	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	*****		
Effluent	MEASUREMENT	*****	*****	*****	*****	*****	*****		Discrete
Nitrate as N	PREMIT REQUIREMENT	*****	*****	*****	*****	*****	*****		
Effluent	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	*****	1.36	Monthly
Kjeldahl Nitrogen as N	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	*****		Discrete
Influent	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	*****		
Kjeldahl Nitrogen as N	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	*****		
Effluent	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	*****		Discrete
Chloride	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	*****		
Influent	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	*****		
I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION. THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.									
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER <b>Susan Crowley</b>	<i>Susan Crowley</i>			TELEPHONE			DATE		
CEM 1428, exp 3-8-13 TYPED OR PRINTED				702 592-7727			12	7	20
COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here) * Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.				SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT			AREA CODE	NUMBER	MONTH DAY

00044/961223-1801  
 \* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.  
 COMMENT AND EXPANSION OF ANY VIOLATIONS (Reference all attachments here),  
 INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

PERMITTEE NAME/ADDRESS  
 Name: Nevada Environmental Response Trust  
 Address: CO Veolia Water NA

510 Fourth Street  
 Henderson, NV 89015

Facility: Nevada Environmental Response Trust  
 Location: Henderson, NV  
 Attn: Susan M. Crowley

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)	
NV 0023060	001
DISCHARGE NUMBER	
PERMIT NUMBER	

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
12	07	01	TO	12	07
FROM					
TO					

PARAMETER		QUANTITY OR LOADING						QUALITY OR CONCENTRATION						NO. EX	FREQUENCY OF ANALYSIS	SAMPLE TYPE
		30 Day Ave	7 Day Average	UNITS	30 Day Ave (mg/l)	7 Day Ave (mg/l)	30 Day Ave(lbs/day)	UNITS	MG/L	0	Quarterly	Discrete				
Chloride	SAMPLE	*****	*****	*****	*	*****	*	*****	*****	*****	*****	*****				
	MEASUREMENT															
	PERMIT															
Effluent	REQUIREMENT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	SAMPLE	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	MEASUREMENT															
	PERMIT															
Chlorate	SAMPLE	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	MEASUREMENT															
	PERMIT															
Effluent	REQUIREMENT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	SAMPLE	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	MEASUREMENT															
	PERMIT															
	REQUIREMENT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	SAMPLE	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	MEASUREMENT															
	PERMIT															
	REQUIREMENT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	SAMPLE	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	MEASUREMENT															
	PERMIT															
	REQUIREMENT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	SAMPLE	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****	
	MEASUREMENT															
	PERMIT															

I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ENSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED, BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS.

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)  
 \* Monitoring frequency is quarterly. Please See April 2012 DMR for analyte information.

Susan Crowley  
 CEM 1428, exp 3-8-13  
 TYPED OR PRINTED

SIGNATURE OF PRINCIPAL EXECUTIVE  
 702 592-7727  
 AREA NUMBER  
 CODE

OFFICER OR AUTHORIZED AGENT

TELEPHONE  
 DATE

00044961223-1801

PAGE 6 OF 6

NO DISCHARGE  
 NOTE: Read instructions before completing this form

## **ATTACHMENT 2**

### **Summary of Supporting Analytical**

Inf-Eff.xlsx

#### **Influent and Effluent**

Inf-Comp n  
Eff-Comp.xlsx

#### **Influent and Effluent Composites**

Wash.xlsx

#### **Wash**

Wash - Mix Zone  
Evaluation.xlsx

#### **LWW 5.5 Mix Zone Evaluation**

M-10.xlsx

#### **M-10**

FBR Solids.xlsx

#### **FBR Solids**

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/2/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/2/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
4/2/2012	Influent	Chlorate by IC	230000	ug/L	20	EPA 300.0
4/2/2012	Influent	Chromium Total ICAP	0.055	mg/L	0.01	EPA 200.7
4/2/2012	Influent	Hexavalent chromium(Dissolved)	51	ug/L	0.02	EPA 218.6
4/2/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
4/2/2012	Influent	Nitrate as Nitrogen by IC	10	mg/L	0.1	EPA 300.0
4/2/2012	Influent	Nitrate as NO <sub>3</sub> (calc)	45	mg/L	0.44	EPA 300.0
4/2/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/2/2012	Influent	Perchlorate	92000	ug/L	4	EPA 314.0
4/2/2012	Influent	Sulfate	1500	mg/L	0.5	EPA 300.0
4/2/2012	Influent	Sulfide,Total	ND	mg/L	0.05	SM4500SD/376.2
4/2/2012	Influent	Total Inorganic Nitrogen-Calc	10	mg/L	0.2	CALC_300.0
4/2/2012	Influent	Total Nitrate, Nitrite-N, CALC	10	mg/L	0.1	EPA 300.0
4/2/2012	Influent	Total phosphorus as P	0.034	mg/L	0.02	SM4500-PE/EPA 365.1
4/2/2012	Effluent	Ammonia Nitrogen	0.14	mg/L	0.05	EPA 350.1
4/2/2012	Effluent	Apparent Color	15	ACU	3	SM 2120B
4/2/2012	Effluent	Chlorate by IC	ND	ug/L	20	EPA 300.0
4/2/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/2/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
4/2/2012	Effluent	Iron Total ICAP	1.8	mg/L	0.02	EPA 200.7
4/2/2012	Effluent	Kjeldahl Nitrogen	0.81	mg/L	0.2	EPA 351.2
4/2/2012	Effluent	Nitrate as Nitrogen by IC	0.61	mg/L	0.013	EPA 300.0
4/2/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/2/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
4/2/2012	Effluent	pH	6.9	Units	0.1	SM4500-HB
4/2/2012	Effluent	Sulfate	1500	mg/L	0.5	EPA 300.0
4/2/2012	Effluent	Sulfide,Total	ND	mg/L	0.05	SM4500SD/376.2
4/2/2012	Effluent	Total Inorganic Nitrogen-Calc	0.75	mg/L	0.2	CALC_300.0
4/2/2012	Effluent	Total phosphorus as P	0.12	mg/L	0.02	SM4500-PE/EPA 365.1
4/2/2012	Effluent	Total Suspended Solids (TSS)	11	mg/L	10	SM 2540D
4/4/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/4/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/9/2012	Influent	1,1,1-Trichloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	1,1,2,2-Tetrachloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	1,1,2-Trichloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	1,1-Dichloroethane	1.3	ug/L	0.5	EPA 624
4/9/2012	Influent	1,1-Dichloroethylene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	1,2,4-Trichlorobenzene	ND	ug/L	5	EPA 625
4/9/2012	Influent	1,2-Dichloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	1,2-Dichloropropane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	1,2-Diphenylhydrazine	ND	ug/L	10	EPA 625
4/9/2012	Influent	2,3,7,8-TCDD	ND	pg/L	5	EPA 1613B
4/9/2012	Influent	2,4,5-Trichlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	2,4,6-Trichlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	2,4-Dichlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	2,4-Dimethylphenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	2,4-Dinitrophenol	ND	ug/L	50	EPA 625
4/9/2012	Influent	2,4-Dinitrotoluene	ND	ug/L	5	EPA 625
4/9/2012	Influent	2,6-Dinitrotoluene	ND	ug/L	5	EPA 625
4/9/2012	Influent	2-Butanone (MEK)	ND	ug/L	5	EPA 624
4/9/2012	Influent	2-Chloroethylvinylether	ND	ug/L	0.5	EPA 8260
4/9/2012	Influent	2-Chloronaphthalene	ND	ug/L	5	EPA 625
4/9/2012	Influent	2-Chlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	2-Hexanone	ND	ug/L	10	EPA 624
4/9/2012	Influent	2-Methylnaphthalene	ND	ug/L	5	EPA 625
4/9/2012	Influent	2-Methylphenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	2-Nitroaniline	ND	ug/L	10	EPA 625

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/9/2012	Influent	2-Nitrophenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	3,3-Dichlorobenzidine	ND	ug/L	50	EPA 625
4/9/2012	Influent	3-Nitroaniline	ND	ug/L	20	EPA 625
4/9/2012	Influent	4,4-DDD	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	4,4-DDE	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	4,4-DDT	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	4,6-Dinitro-o-cresol	ND	ug/L	50	EPA 625
4/9/2012	Influent	4-Bromophenylphenylether	ND	ug/L	5	EPA 625
4/9/2012	Influent	4-Chloroaniline	ND	ug/L	5	EPA 625
4/9/2012	Influent	4-Chlorophenylphenylether	ND	ug/L	5	EPA 625
4/9/2012	Influent	4-Methyl-2-Pentanone (MIBK)	ND	ug/L	5	EPA 624
4/9/2012	Influent	4-Methylphenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	4-Nitroaniline	ND	ug/L	20	EPA 625
4/9/2012	Influent	4-Nitrophenol	ND	ug/L	10	EPA 625
4/9/2012	Influent	Acenaphthene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Acenaphthylene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Acetone	ND	ug/L	10	EPA 624
4/9/2012	Influent	Acrolein (Screen)	NA	ug/L	25	EPA 624
4/9/2012	Influent	Acrylonitrile (Screen)	NA	ug/L	25	EPA 624
4/9/2012	Influent	Aldrin	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	alpha-BHC	0.26	ug/L	0.098	EPA 608
4/9/2012	Influent	alpha-Chlordane	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Aniline	ND	ug/L	10	EPA 625
4/9/2012	Influent	Anthracene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Antimony Total ICAP/MS	ND	ug/L	1	EPA 200.8
4/9/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
4/9/2012	Influent	Arsenic III	30	ug/L	1	EPA 200.8
4/9/2012	Influent	Arsenic Total ICAP/MS	160	ug/L	1	EPA 200.8
4/9/2012	Influent	Arsenic Total ICAP/MS	75	ug/L	1	EPA 200.8
4/9/2012	Influent	Arsenic V	46	ug/L	1	EPA 200.8
4/9/2012	Influent	Asbestos by TEM - >10 microns	ND	MFL	0.2	EPA 100.2
4/9/2012	Influent	Atrazine	ND	ug/L	0.05	EPA 525.2
4/9/2012	Influent	Barium Total ICAP/MS	36	ug/L	2	EPA 200.8
4/9/2012	Influent	Benzene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Benzidine	ND	ug/L	50	EPA 625
4/9/2012	Influent	Benzo(a)anthracene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Benzo(a)pyrene	ND	ug/L	0.02	EPA 525.2
4/9/2012	Influent	Benzo(a)pyrene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Benzo(b)fluoranthene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Benzo(g,h,i)perylene	ND	ug/L	10	EPA 625
4/9/2012	Influent	Benzo(k)fluoranthene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Benzoic Acid	ND	ug/L	50	EPA 625
4/9/2012	Influent	Benzyl Alcohol	ND	ug/L	5	EPA 625
4/9/2012	Influent	Beryllium Total ICAP/MS	ND	ug/L	1	EPA 200.8
4/9/2012	Influent	beta-BHC	0.39	ug/L	0.098	EPA 608
4/9/2012	Influent	Biochemical Oxygen Demand,Totl	ND	mg/L	3	SM5210B 405.1
4/9/2012	Influent	bis(2-Chloroethoxy)methane	ND	ug/L	10	EPA 625
4/9/2012	Influent	bis(2-Chloroethyl)ether	ND	ug/L	10	EPA 625
4/9/2012	Influent	bis(2-Chloroisopropyl)ether	ND	ug/L	10	EPA 625
4/9/2012	Influent	Boron Total ICAP	2.5	mg/L	0.05	EPA 200.7
4/9/2012	Influent	Bromodichloromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Bromoform	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Bromomethane (Methyl Bromide)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Butylbenzylphthalate	ND	ug/L	5	EPA 625
4/9/2012	Influent	Cadmium Total ICAP/MS	ND	ug/L	0.5	EPA 200.8
4/9/2012	Influent	Carbon disulfide	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Carbon Tetrachloride	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Chemical Oxygen Demand (COD)	ND	mg/L	5	EPA 410.4

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/9/2012	Influent	Chloride	1800	mg/L	1	EPA 300.0
4/9/2012	Influent	Chlorobenzene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Chlorodibromomethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Chloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Chloroform (Trichloromethane)	39	ug/L	0.5	EPA 624
4/9/2012	Influent	Chloromethane(Methyl Chloride)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Chromium Total ICAP	0.047	mg/L	0.01	EPA 200.7
4/9/2012	Influent	Chrysene	ND	ug/L	5	EPA 625
4/9/2012	Influent	cis-1,2-Dichloroethylene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	cis-1,3-Dichloropropene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Copper Total ICAP/MS	61	ug/L	2	EPA 200.8
4/9/2012	Influent	Cyanide by manual distillation	ND	mg/L	0.005	EPA 335.4
4/9/2012	Influent	delta-BHC	0.46	ug/L	0.098	EPA 608
4/9/2012	Influent	Di-(2-Ethylhexyl)adipate	ND	ug/L	0.6	EPA 525.2
4/9/2012	Influent	Di(2-Ethylhexyl)phthalate	ND	ug/L	0.6	EPA 525.2
4/9/2012	Influent	Di(2-Ethylhexyl)phthalate	ND	ug/L	4	EPA 625
4/9/2012	Influent	Dibenz(a,h)anthracene	ND	ug/L	10	EPA 625
4/9/2012	Influent	Dibenzofuran	ND	ug/L	5	EPA 625
4/9/2012	Influent	Dichlorodifluoromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Dichloromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Dieldrin	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Diethylphthalate	ND	ug/L	5	EPA 625
4/9/2012	Influent	Dimethylphthalate	ND	ug/L	5	EPA 625
4/9/2012	Influent	Di-n-butylphthalate	ND	ug/L	10	EPA 625
4/9/2012	Influent	Di-n-octylphthalate	ND	ug/L	10	EPA 625
4/9/2012	Influent	Endosulfan I (Alpha)	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Endosulfan II (Beta)	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Endosulfan Sulfate	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Endrin	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Endrin Aldehyde	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Endrin Ketone	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Ethyl benzene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Fluoranthene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Fluorene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Gamma-BHC	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	gamma-Chlordane	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Heptachlor	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Heptachlor Epoxide	ND	ug/L	0.098	EPA 608
4/9/2012	Influent	Hexachlorobenzene	ND	ug/L	0.05	EPA 525.2
4/9/2012	Influent	Hexachlorobenzene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Hexachlorobutadiene	ND	ug/L	10	EPA 625
4/9/2012	Influent	Hexachlorocyclopentadiene	ND	ug/L	0.05	EPA 525.2
4/9/2012	Influent	Hexachlorocyclopentadiene	ND	ug/L	10	EPA 625
4/9/2012	Influent	Hexachloroethane	ND	ug/L	5	EPA 625
4/9/2012	Influent	Hexavalent chromium(Dissolved)	43	ug/L	0.02	EPA 218.6
4/9/2012	Influent	Indeno(1,2,3-c,d)pyrene	ND	ug/L	10	EPA 625
4/9/2012	Influent	Iron Total ICAP	0.021	mg/L	0.02	EPA 200.7
4/9/2012	Influent	Isophorone	ND	ug/L	5	EPA 625
4/9/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
4/9/2012	Influent	Lead Total ICAP/MS	ND	ug/L	0.5	EPA 200.8
4/9/2012	Influent	m,p-Xylenes	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Magnesium Total ICAP	130	mg/L	0.1	EPA 200.7
4/9/2012	Influent	Manganese Total ICAP	0.52	mg/L	0.002	EPA 200.7
4/9/2012	Influent	m-Dichlorobenzene (1,3-DCB)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Mercury	ND	ug/L	0.2	EPA 245.1
4/9/2012	Influent	Methoxychlor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	Methyl Tert-butyl ether (MTBE)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Molinate	ND	ug/L	0.1	EPA 525.2

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/9/2012	Influent	Molybdenum Total ICAP/MS	70	ug/L	2	EPA 200.8
4/9/2012	Influent	Naphthalene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Nickel Total ICAP/MS	25	ug/L	5	EPA 200.8
4/9/2012	Influent	Nitrobenzene	ND	ug/L	5	EPA 625
4/9/2012	Influent	N-Nitrosodimethylamine	ND	ug/L	5	EPA 625
4/9/2012	Influent	N-Nitrosodi-N-propylamine	ND	ug/L	5	EPA 625
4/9/2012	Influent	N-Nitrosodiphenylamine	ND	ug/L	5	EPA 625
4/9/2012	Influent	o-Dichlorobenzene (1,2-DCB)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Oil and Grease by 1664(subbed)	ND	mg/L	5	EPA 1664
4/9/2012	Influent	o-Xylene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	PCB 1016 Aroclor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	PCB 1221 Aroclor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	PCB 1232 Aroclor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	PCB 1242 Aroclor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	PCB 1248 Aroclor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	PCB 1254 Aroclor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	PCB 1260 Aroclor	ND	ug/L	0.982	EPA 608
4/9/2012	Influent	p-Chloro-m-cresol	ND	ug/L	5	EPA 625
4/9/2012	Influent	p-Dichlorobenzene (1,4-DCB)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Pentachlorophenol	ND	ug/L	20	EPA 625
4/9/2012	Influent	Phenanthrene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Phenol	ND	ug/L	5	EPA 625
4/9/2012	Influent	Potassium Total ICAP	27	mg/L	1	EPA 200.7
4/9/2012	Influent	Pyrene	ND	ug/L	5	EPA 625
4/9/2012	Influent	Radium 226	<0.935	pCi/L	0.935	EPA 903.1
4/9/2012	Influent	Radium 226 Minimal Detectable	0.935	pCi/L	0	EPA 903.1
4/9/2012	Influent	Radium 226 Two Sigma Error	0.411	pCi/L	0	EPA 903.1
4/9/2012	Influent	Radium 228	<0.741	pCi/L	0.741	EPA 904.0
4/9/2012	Influent	Radium 228 Minimum Detectable	0.741	pCi/L	0	EPA 904.0
4/9/2012	Influent	Radium 228 Two Sigma Error	0.326	pCi/L	0	EPA 904.0
4/9/2012	Influent	Selenium Total ICAP/MS	ND	ug/L	5	EPA 200.8
4/9/2012	Influent	Silver Total ICAP/MS	ND	ug/L	0.5	EPA 200.8
4/9/2012	Influent	Simazine	ND	ug/L	0.05	EPA 525.2
4/9/2012	Influent	Sodium Total ICAP	1200	mg/L	1	EPA 200.7
4/9/2012	Influent	Strontium Total ICAP	8.5	mg/L	0.01	EPA 200.7
4/9/2012	Influent	Styrene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Sulfate	1400	mg/L	0.5	EPA 300.0
4/9/2012	Influent	Surfactants	1.2	mg/L	0.05	SM 5540C/EPA 425.1
4/9/2012	Influent	Tetrachloroethylene (PCE)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Tetrahydrofuran	ND	ug/L	10	EPA 624
4/9/2012	Influent	Thallium Total ICAP/MS	ND	ug/L	1	EPA 200.8
4/9/2012	Influent	Thiobencarb (ELAP)	ND	ug/L	0.2	EPA 525.2
4/9/2012	Influent	Toluene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Total 1,3-Dichloropropene	ND	ug/L	1	EPA 624
4/9/2012	Influent	Total Dissolved Solids (TDS)	5200	mg/L	10	E160.1/SM2540C
4/9/2012	Influent	Total Organic Carbon	2.2	mg/L	0.3	SM5310C/E415.3
4/9/2012	Influent	Total phosphorus as P	0.028	mg/L	0.02	SM4500-PE/EPA 365.1
4/9/2012	Influent	Total Suspended Solids (TSS)	ND	mg/L	10	SM 2540D
4/9/2012	Influent	Toxaphene	ND	ug/L	1.96	EPA 608
4/9/2012	Influent	trans-1,2-Dichloroethylene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	trans-1,3-Dichloropropene	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Trichloroethylene (TCE)	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Trichlorofluoromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Influent	Vanadium Total ICAP/MS	100	ug/L	3	EPA 200.8
4/9/2012	Influent	Vinyl Acetate	ND	ug/L	10	EPA 624
4/9/2012	Influent	Vinyl chloride (VC)	ND	ug/L	0.3	EPA 624
4/9/2012	Influent	Zinc Total ICAP/MS	ND	ug/L	20	EPA 200.8
4/9/2012	Effluent	1,1,1-Trichloroethane	ND	ug/L	0.5	EPA 624

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/9/2012	Effluent	1,1,2,2-Tetrachloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	1,1,2-Trichloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	1,1-Dichloroethane	0.95	ug/L	0.5	EPA 624
4/9/2012	Effluent	1,1-Dichloroethylene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	1,2,4-Trichlorobenzene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	1,2-Dichloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	1,2-Dichloropropane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	1,2-Diphenylhydrazine	ND	ug/L	10	EPA 625
4/9/2012	Effluent	2,3,7,8-TCDD	ND	pg/L	5	EPA 1613B
4/9/2012	Effluent	2,4,5-Trichlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2,4,6-Trichlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2,4-Dichlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2,4-Dimethylphenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2,4-Dinitrophenol	ND	ug/L	50	EPA 625
4/9/2012	Effluent	2,4-Dinitrotoluene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2,6-Dinitrotoluene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2-Butanone (MEK)	ND	ug/L	5	EPA 624
4/9/2012	Effluent	2-Chloroethylvinylether	ND	ug/L	0.5	EPA 8260
4/9/2012	Effluent	2-Chloronaphthalene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2-Chlorophenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2-Hexanone	ND	ug/L	10	EPA 624
4/9/2012	Effluent	2-Methylnaphthalene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2-Methylphenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	2-Nitroaniline	ND	ug/L	10	EPA 625
4/9/2012	Effluent	2-Nitrophenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	3,3-Dichlorobenzidine	ND	ug/L	50	EPA 625
4/9/2012	Effluent	3-Nitroaniline	ND	ug/L	20	EPA 625
4/9/2012	Effluent	4,4-DDD	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	4,4-DDE	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	4,4-DDT	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	4,6-Dinitro-o-cresol	ND	ug/L	50	EPA 625
4/9/2012	Effluent	4-Bromophenylphenylether	ND	ug/L	5	EPA 625
4/9/2012	Effluent	4-Chloroaniline	ND	ug/L	5	EPA 625
4/9/2012	Effluent	4-Chlorophenylphenylether	ND	ug/L	5	EPA 625
4/9/2012	Effluent	4-Methyl-2-Pentanone (MIBK)	ND	ug/L	5	EPA 624
4/9/2012	Effluent	4-Methylphenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	4-Nitroaniline	ND	ug/L	20	EPA 625
4/9/2012	Effluent	4-Nitrophenol	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Acenaphthene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Acenaphthylene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Acetone	ND	ug/L	10	EPA 624
4/9/2012	Effluent	Acrolein (Screen)	NA	ug/L	25	EPA 624
4/9/2012	Effluent	Acrylonitrile (Screen)	NA	ug/L	25	EPA 624
4/9/2012	Effluent	Aldrin	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	alpha-BHC	0.11	ug/L	0.095	EPA 608
4/9/2012	Effluent	alpha-Chlordane	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Aniline	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Anthracene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Antimony Total ICAP/MS	ND	ug/L	1	EPA 200.8
4/9/2012	Effluent	Apparent Color	15	ACU	3	SM 2120B
4/9/2012	Effluent	Arsenic III	8.2	ug/L	1	EPA 200.8
4/9/2012	Effluent	Arsenic Total ICAP/MS	20	ug/L	1	EPA 200.8
4/9/2012	Effluent	Arsenic V	12	ug/L	1	EPA 200.8
4/9/2012	Effluent	Asbestos by TEM - >10 microns	ND	MFL	3.8	EPA 100.2
4/9/2012	Effluent	Atrazine	ND	ug/L	0.05	EPA 525.2
4/9/2012	Effluent	Barium Total ICAP/MS	23	ug/L	2	EPA 200.8
4/9/2012	Effluent	Benzene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Benzidine	ND	ug/L	50	EPA 625

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<b>Sample Date</b>	<b>Sample ID</b>	<b>Analyte</b>	<b>Final</b>	<b>Units</b>	<b>MRL</b>	<b>Method</b>
4/9/2012	Effluent	Benzo(a)anthracene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Benzo(a)pyrene	ND	ug/L	0.02	EPA 525.2
4/9/2012	Effluent	Benzo(a)pyrene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Benzo(b)fluoranthene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Benzo(g,h,i)perylene	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Benzo(k)fluoranthene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Benzoic Acid	ND	ug/L	50	EPA 625
4/9/2012	Effluent	Benzyl Alcohol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Beryllium Total ICAP/MS	ND	ug/L	1	EPA 200.8
4/9/2012	Effluent	beta-BHC	0.29	ug/L	0.095	EPA 608
4/9/2012	Effluent	Biochemical Oxygen Demand,Totl	ND	mg/L	3	SM5210B 405.1
4/9/2012	Effluent	bis(2-Chloroethoxy)methane	ND	ug/L	10	EPA 625
4/9/2012	Effluent	bis(2-Chloroethyl)ether	ND	ug/L	10	EPA 625
4/9/2012	Effluent	bis(2-Chloroisopropyl)ether	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Boron Total ICAP	2.5	mg/L	0.05	EPA 200.7
4/9/2012	Effluent	Bromodichloromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Bromoform	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Bromomethane (Methyl Bromide)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Butylbenzylphthalate	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Cadmium Total ICAP/MS	0.63	ug/L	0.5	EPA 200.8
4/9/2012	Effluent	Carbon disulfide	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Carbon Tetrachloride	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Chemical Oxygen Demand (COD)	ND	mg/L	5	EPA 410.4
4/9/2012	Effluent	Chloride	1700	mg/L	1	EPA 300.0
4/9/2012	Effluent	Chlorobenzene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Chlorodibromomethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Chloroethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Chloroform (Trichloromethane)	1	ug/L	0.5	EPA 624
4/9/2012	Effluent	Chloromethane(Methyl Chloride)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/9/2012	Effluent	Chrysene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	cis-1,2-Dichloroethylene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	cis-1,3-Dichloropropene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Copper Total ICAP/MS	ND	ug/L	2	EPA 200.8
4/9/2012	Effluent	Cyanide by manual distillation	ND	mg/L	0.005	EPA 335.4
4/9/2012	Effluent	delta-BHC	0.27	ug/L	0.095	EPA 608
4/9/2012	Effluent	Di-(2-Ethylhexyl)adipate	ND	ug/L	0.6	EPA 525.2
4/9/2012	Effluent	Di(2-Ethylhexyl)phthalate	ND	ug/L	0.6	EPA 525.2
4/9/2012	Effluent	Di(2-Ethylhexyl)phthalate	ND	ug/L	4	EPA 625
4/9/2012	Effluent	Dibenz(a,h)anthracene	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Dibenzofuran	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Dichlorodifluoromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Dichloromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Dieldrin	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Diethylphthalate	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Dimethylphthalate	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Di-n-butylphthalate	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Di-n-octylphthalate	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Endosulfan I (Alpha)	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Endosulfan II (Beta)	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Endosulfan Sulfate	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Endrin	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Endrin Aldehyde	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Endrin Ketone	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Ethyl benzene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Fluoranthene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Fluorene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Gamma-BHC	ND	ug/L	0.095	EPA 608

**NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary**

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/9/2012	Effluent	gamma-Chlordane	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Heptachlor	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Heptachlor Epoxide	ND	ug/L	0.095	EPA 608
4/9/2012	Effluent	Hexachlorobenzene	ND	ug/L	0.05	EPA 525.2
4/9/2012	Effluent	Hexachlorobenzene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Hexachlorobutadiene	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Hexachlorocyclopentadiene	ND	ug/L	0.05	EPA 525.2
4/9/2012	Effluent	Hexachlorocyclopentadiene	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Hexachloroethane	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
4/9/2012	Effluent	Indeno(1,2,3-c,d)pyrene	ND	ug/L	10	EPA 625
4/9/2012	Effluent	Iron Total ICAP	1.9	mg/L	0.02	EPA 200.7
4/9/2012	Effluent	Isophorone	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Kjeldahl Nitrogen	0.96	mg/L	0.2	EPA 351.2
4/9/2012	Effluent	Lead Total ICAP/MS	ND	ug/L	0.5	EPA 200.8
4/9/2012	Effluent	m,p-Xylenes	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Magnesium Total ICAP	130	mg/L	0.1	EPA 200.7
4/9/2012	Effluent	Manganese Total ICAP/MS	620	ug/L	2	EPA 200.8
4/9/2012	Effluent	m-Dichlorobenzene (1,3-DCB)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Mercury	ND	ug/L	0.2	EPA 245.1
4/9/2012	Effluent	Methoxychlor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	Methyl Tert-butyl ether (MTBE)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Molinate	ND	ug/L	0.1	EPA 525.2
4/9/2012	Effluent	Molybdenum Total ICAP/MS	270	ug/L	2	EPA 200.8
4/9/2012	Effluent	Naphthalene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Nickel Total ICAP/MS	42	ug/L	5	EPA 200.8
4/9/2012	Effluent	Nitrobenzene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	N-Nitrosodimethylamine	ND	ug/L	5	EPA 625
4/9/2012	Effluent	N-Nitrosodi-N-propylamine	ND	ug/L	5	EPA 625
4/9/2012	Effluent	N-Nitrosodiphenylamine	ND	ug/L	5	EPA 625
4/9/2012	Effluent	o-Dichlorobenzene (1,2-DCB)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Oil and Grease by 1664(subbed)	ND	mg/L	5	EPA 1664
4/9/2012	Effluent	o-Xylene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	PCB 1016 Aroclor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	PCB 1221 Aroclor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	PCB 1232 Aroclor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	PCB 1242 Aroclor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	PCB 1248 Aroclor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	PCB 1254 Aroclor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	PCB 1260 Aroclor	ND	ug/L	0.952	EPA 608
4/9/2012	Effluent	p-Chloro-m-cresol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	p-Dichlorobenzene (1,4-DCB)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Pentachlorophenol	ND	ug/L	20	EPA 625
4/9/2012	Effluent	pH	6.8	Units	0.1	SM4500-HB
4/9/2012	Effluent	Phenanthrene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Phenol	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Potassium Total ICAP	26	mg/L	1	EPA 200.7
4/9/2012	Effluent	Pyrene	ND	ug/L	5	EPA 625
4/9/2012	Effluent	Radium 226	<0.965	pCi/L	0.965	EPA 903.1
4/9/2012	Effluent	Radium 226 Minimal Detectable	0.965	pCi/L	0	EPA 903.1
4/9/2012	Effluent	Radium 226 Two Sigma Error	0.398	pCi/L	0	EPA 903.1
4/9/2012	Effluent	Radium 228	<0.909	pCi/L	0.909	EPA 904.0
4/9/2012	Effluent	Radium 228 Minimum Detectable	0.909	pCi/L	0	EPA 904.0
4/9/2012	Effluent	Radium 228 Two Sigma Error	0.412	pCi/L	0	EPA 904.0
4/9/2012	Effluent	Selenium Total ICAP/MS	ND	ug/L	5	EPA 200.8
4/9/2012	Effluent	Silver Total ICAP/MS	ND	ug/L	0.5	EPA 200.8
4/9/2012	Effluent	Simazine	ND	ug/L	0.05	EPA 525.2
4/9/2012	Effluent	Sodium Total ICAP	1200	mg/L	1	EPA 200.7

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/9/2012	Effluent	Strontium Total ICAP	8.5	mg/L	0.01	EPA 200.7
4/9/2012	Effluent	Styrene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Sulfate	1500	mg/L	0.5	EPA 300.0
4/9/2012	Effluent	Surfactants	0.18	mg/L	0.05	SM 5540C/EPA 425.1
4/9/2012	Effluent	Tetrachloroethylene (PCE)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Tetrahydrofuran	ND	ug/L	10	EPA 624
4/9/2012	Effluent	Thallium Total ICAP/MS	ND	ug/L	1	EPA 200.8
4/9/2012	Effluent	Thiobencarb (ELAP)	ND	ug/L	0.2	EPA 525.2
4/9/2012	Effluent	Toluene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Total 1,3-Dichloropropene	ND	ug/L	1	EPA 624
4/9/2012	Effluent	Total Dissolved Solids (TDS)	5100	mg/L	10	E160.1/SM2540C
4/9/2012	Effluent	Total Organic Carbon	2	mg/L	0.3	SM5310C/E415.3
4/9/2012	Effluent	Total phosphorus as P	0.26	mg/L	0.02	SM4500-PE/EPA 365.1
4/9/2012	Effluent	Total Suspended Solids (TSS)	15	mg/L	10	SM 2540D
4/9/2012	Effluent	Toxaphene	ND	ug/L	2	EPA 608
4/9/2012	Effluent	trans-1,2-Dichloroethylene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	trans-1,3-Dichloropropene	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Trichloroethylene (TCE)	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Trichlorofluoromethane	ND	ug/L	0.5	EPA 624
4/9/2012	Effluent	Vanadium Total ICAP/MS	25	ug/L	3	EPA 200.8
4/9/2012	Effluent	Vinyl Acetate	ND	ug/L	10	EPA 624
4/9/2012	Effluent	Vinyl chloride (VC)	ND	ug/L	0.3	EPA 624
4/9/2012	Effluent	Zinc Total ICAP/MS	ND	ug/L	20	EPA 200.8
4/11/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/11/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/12/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/12/2012	Influent	Chlorate by IC	220000	ug/L	10	EPA 300.0
4/12/2012	Influent	Nitrate as Nitrogen by IC	13	mg/L	0.1	EPA 300.0
4/12/2012	Influent	Nitrate as NO3 (calc)	56	mg/L	0.44	EPA 300.0
4/12/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/12/2012	Influent	Perchlorate	84000	ug/L	4	EPA 314.0
4/12/2012	Influent	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0
4/12/2012	Influent	Total Nitrate, Nitrite-N, CALC	13	mg/L	0.1	EPA 300.0
4/12/2012	Effluent	Ammonia Nitrogen	0.053	mg/L	0.05	EPA 350.1
4/12/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
4/12/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/12/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/12/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
4/12/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
4/16/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/16/2012	Influent	Apparent Color	ND	ACU	3	SM 2120B
4/16/2012	Influent	Chlorate by IC	210000	ug/L	10	EPA 300.0
4/16/2012	Influent	Chromium Total ICAP	0.058	mg/L	0.01	EPA 200.7
4/16/2012	Influent	Hexavalent chromium(Dissolved)	45	ug/L	0.02	EPA 218.6
4/16/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
4/16/2012	Influent	Nitrate as Nitrogen by IC	9.7	mg/L	0.1	EPA 300.0
4/16/2012	Influent	Nitrate as NO3 (calc)	43	mg/L	0.44	EPA 300.0
4/16/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/16/2012	Influent	Perchlorate	110000	ug/L	4	EPA 314.0
4/16/2012	Influent	Total Inorganic Nitrogen-Calc	9.7	mg/L	0.2	CALC_300.0
4/16/2012	Influent	Total Nitrate, Nitrite-N, CALC	9.7	mg/L	0.1	EPA 300.0
4/16/2012	Influent	Total phosphorus as P	ND	mg/L	0.02	SM4500-PE/EPA 365.1
4/16/2012	Effluent	Ammonia Nitrogen	0.058	mg/L	0.05	EPA 350.1
4/16/2012	Effluent	Apparent Color	ND	ACU	3	SM 2120B
4/16/2012	Effluent	Chlorate by IC	62	ug/L	10	EPA 300.0
4/16/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/16/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
4/16/2012	Effluent	Iron Total ICAP	2.6	mg/L	0.02	EPA 200.7

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<b>Sample Date</b>	<b>Sample ID</b>	<b>Analyte</b>	<b>Final</b>	<b>Units</b>	<b>MRL</b>	<b>Method</b>
4/16/2012	Effluent	Kjeldahl Nitrogen	0.85	mg/L	0.2	EPA 351.2
4/16/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/16/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/16/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
4/16/2012	Effluent	pH	6.8	Units	0.1	SM4500-HB
4/16/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
4/16/2012	Effluent	Total phosphorus as P	0.2	mg/L	0.02	SM4500-PE/EPA 365.1
4/16/2012	Effluent	Total Suspended Solids (TSS)	16	mg/L	10	SM 2540D
4/18/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/18/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/23/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/23/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
4/23/2012	Influent	Chlorate by IC	220000	ug/L	10	EPA 300.0
4/23/2012	Influent	Chromium Total ICAP	0.026	mg/L	0.01	EPA 200.7
4/23/2012	Influent	Hexavalent chromium(Dissolved)	21	ug/L	0.02	EPA 218.6
4/23/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
4/23/2012	Influent	Nitrate as Nitrogen by IC	9.6	mg/L	0.1	EPA 300.0
4/23/2012	Influent	Nitrate as NO3 (calc)	42	mg/L	0.44	EPA 300.0
4/23/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/23/2012	Influent	Perchlorate	110000	ug/L	4	EPA 314.0
4/23/2012	Influent	Total Inorganic Nitrogen-Calc	9.6	mg/L	0.2	CALC_300.0
4/23/2012	Influent	Total Nitrate, Nitrite-N, CALC	9.6	mg/L	0.1	EPA 300.0
4/23/2012	Influent	Total phosphorus as P	ND	mg/L	0.02	SM4500-PE/EPA 365.1
4/23/2012	Effluent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/23/2012	Effluent	Apparent Color	15	ACU	3	SM 2120B
4/23/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
4/23/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/23/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
4/23/2012	Effluent	Iron Total ICAP	1.4	mg/L	0.02	EPA 200.7
4/23/2012	Effluent	Kjeldahl Nitrogen	0.86	mg/L	0.2	EPA 351.2
4/23/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/23/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/23/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
4/23/2012	Effluent	pH	7	Units	0.1	SM4500-HB
4/23/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
4/23/2012	Effluent	Total phosphorus as P	0.092	mg/L	0.02	SM4500-PE/EPA 365.1
4/23/2012	Effluent	Total Suspended Solids (TSS)	12	mg/L	10	SM 2540D
4/25/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/25/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
4/30/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/30/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
4/30/2012	Influent	Chlorate by IC	2000000	ug/L	10	EPA 300.0
4/30/2012	Influent	Chromium Total ICAP	0.032	mg/L	0.01	EPA 200.7
4/30/2012	Influent	Hexavalent chromium(Dissolved)	22	ug/L	0.02	EPA 218.6
4/30/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
4/30/2012	Influent	Nitrate as Nitrogen by IC	9.2	mg/L	0.1	EPA 300.0
4/30/2012	Influent	Nitrate as NO3 (calc)	40	mg/L	0.44	EPA 300.0
4/30/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/30/2012	Influent	Perchlorate	97000	ug/L	4	EPA 314.0
4/30/2012	Influent	Total Inorganic Nitrogen-Calc	9.2	mg/L	0.2	CALC_300.0
4/30/2012	Influent	Total Nitrate, Nitrite-N, CALC	9.2	mg/L	0.1	EPA 300.0
4/30/2012	Influent	Total phosphorus as P	ND	mg/L	0.02	SM4500-PE/EPA 365.1
4/30/2012	Effluent	Ammonia Nitrogen	0.087	mg/L	0.05	EPA 350.1
4/30/2012	Effluent	Apparent Color	20	ACU	3	SM 2120B
4/30/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
4/30/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/30/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
4/30/2012	Effluent	Iron Total ICAP	2.2	mg/L	0.02	EPA 200.7

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/30/2012	Effluent	Kjeldahl Nitrogen	0.96	mg/L	0.2	EPA 351.2
4/30/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/30/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/30/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
4/30/2012	Effluent	pH	7.4	Units	0.1	SM4500-HB
4/30/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
4/30/2012	Effluent	Total phosphorus as P	0.15	mg/L	0.02	SM4500-PE/EPA 365.1
4/30/2012	Effluent	Total Suspended Solids (TSS)	13	mg/L	10	SM 2540D
5/2/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/2/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/7/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/7/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
5/7/2012	Influent	Chlorate by IC	210000	ug/L	10	EPA 300.0
5/7/2012	Influent	Chromium Total ICAP	0.056	mg/L	0.01	EPA 200.7
5/7/2012	Influent	Hexavalent chromium(Dissolved)	52	ug/L	0.02	EPA 218.6
5/7/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
5/7/2012	Influent	Nitrate as Nitrogen by IC	9.9	mg/L	0.1	EPA 300.0
5/7/2012	Influent	Nitrate as NO3 (calc)	43	mg/L	0.44	EPA 300.0
5/7/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/7/2012	Influent	Perchlorate	110000	ug/L	4	EPA 314.0
5/7/2012	Influent	Sulfate	1500	mg/L	0.5	EPA 300.0
5/7/2012	Influent	Sulfide,Total	ND	mg/L	0.05	SM4500SD/376.2
5/7/2012	Influent	Total Inorganic Nitrogen-Calc	9.9	mg/L	0.2	CALC_300.0
5/7/2012	Influent	Total Nitrate, Nitrite-N, CALC	9.9	mg/L	0.1	EPA 300.0
5/7/2012	Influent	Total phosphorus as P	ND	mg/L	0.02	SM4500-PE/EPA 365.1
5/7/2012	Effluent	Ammonia Nitrogen	0.11	mg/L	0.05	EPA 350.1
5/7/2012	Effluent	Apparent Color	20	ACU	3	SM 2120B
5/7/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
5/7/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
5/7/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
5/7/2012	Effluent	Iron Total ICAP	2.6	mg/L	0.02	EPA 200.7
5/7/2012	Effluent	Kjeldahl Nitrogen	0.72	mg/L	0.2	EPA 351.2
5/7/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/7/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/7/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
5/7/2012	Effluent	pH	7.4	Units	0.1	SM4500-HB
5/7/2012	Effluent	Sulfate	1400	mg/L	0.5	EPA 300.0
5/7/2012	Effluent	Sulfide,Total	ND	mg/L	0.05	SM4500SD/376.2
5/7/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
5/7/2012	Effluent	Total phosphorus as P	0.14	mg/L	0.02	SM4500-PE/EPA 365.1
5/7/2012	Effluent	Total Suspended Solids (TSS)	17	mg/L	10	SM 2540D
5/9/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/9/2012	Effluent	Carbonaceous BOD	3.3	mg/L	3	SM 5210B
5/14/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/14/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
5/14/2012	Influent	Chlorate by IC	230000	ug/L	10	EPA 300.0
5/14/2012	Influent	Chromium Total ICAP	0.051	mg/L	0.01	EPA 200.7
5/14/2012	Influent	Hexavalent chromium(Dissolved)	43	ug/L	0.02	EPA 218.6
5/14/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
5/14/2012	Influent	Nitrate as Nitrogen by IC	9.7	mg/L	0.1	EPA 300.0
5/14/2012	Influent	Nitrate as NO3 (calc)	43	mg/L	0.44	EPA 300.0
5/14/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/14/2012	Influent	Perchlorate	92000	ug/L	4	EPA 314.0
5/14/2012	Influent	Total Inorganic Nitrogen-Calc	9.7	mg/L	0.2	CALC_300.0
5/14/2012	Influent	Total Nitrate, Nitrite-N, CALC	9.7	mg/L	0.1	EPA 300.0
5/14/2012	Influent	Total phosphorus as P	ND	mg/L	0.02	SM4500-PE/EPA 365.1
5/14/2012	Effluent	Ammonia Nitrogen	0.11	mg/L	0.05	EPA 350.1
5/14/2012	Effluent	Apparent Color	30	ACU	3	SM 2120B

NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
5/14/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
5/14/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
5/14/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
5/14/2012	Effluent	Iron Total ICAP	2.7	mg/L	0.02	EPA 200.7
5/14/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/14/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/14/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
5/14/2012	Effluent	pH	7.2	Units	0.1	SM4500-HB
5/14/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
5/14/2012	Effluent	Total Suspended Solids (TSS)	11	mg/L	10	SM 2540D
5/16/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/16/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/21/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/21/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
5/21/2012	Influent	Chlorate by IC	230000	ug/L	10	EPA 300.0
5/21/2012	Influent	Chromium Total ICAP	0.017	mg/L	0.01	EPA 200.7
5/21/2012	Influent	Hexavalent chromium(Dissolved)	15	ug/L	0.02	EPA 218.6
5/21/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
5/21/2012	Influent	Nitrate as Nitrogen by IC	11	mg/L	0.1	EPA 300.0
5/21/2012	Influent	Nitrate as NO3 (calc)	48	mg/L	0.44	EPA 300.0
5/21/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/21/2012	Influent	Perchlorate	110000	ug/L	4	EPA 314.0
5/21/2012	Influent	Total Inorganic Nitrogen-Calc	11	mg/L	0.2	CALC_300.0
5/21/2012	Influent	Total Nitrate, Nitrite-N, CALC	11	mg/L	0.1	EPA 300.0
5/21/2012	Influent	Total phosphorus as P	ND	mg/L	0.02	SM4500-PE/EPA 365.1
5/21/2012	Effluent	Alpha, Min Detectable Activity	2.08	pCi/L	0	
5/21/2012	Effluent	Alpha, Two Sigma Error	2.8	pCi/L	0	SM 7110C
5/21/2012	Effluent	Ammonia Nitrogen	0.16	mg/L	0.05	EPA 350.1
5/21/2012	Effluent	Apparent Color	15	ACU	3	SM 2120B
5/21/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
5/21/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
5/21/2012	Effluent	Gross Alpha by Coprecipitation	14	pCi/L	2.08	SM 7110C
5/21/2012	Effluent	Hexavalent chromium(Dissolved)	0.13	ug/L	0.02	EPA 218.6
5/21/2012	Effluent	Iron Total ICAP	3.4	mg/L	0.02	EPA 200.7
5/21/2012	Effluent	Kjeldahl Nitrogen	7	mg/L	0.2	EPA 351.2
5/21/2012	Effluent	Nitrate as Nitrogen by IC	0.49	mg/L	0.013	EPA 300.0
5/21/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/21/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
5/21/2012	Effluent	pH	7.2	Units	0.1	SM4500-HB
5/21/2012	Effluent	Total Inorganic Nitrogen-Calc	0.66	mg/L	0.2	CALC_300.0
5/21/2012	Effluent	Total phosphorus as P	0.12	mg/L	0.02	SM4500-PE/EPA 365.1
5/21/2012	Effluent	Total Suspended Solids (TSS)	15	mg/L	10	
5/23/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/23/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/29/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/29/2012	Influent	Apparent Color	10	ACU	3	SM 2120B
5/29/2012	Influent	Chlorate by IC	210000	ug/L	10	EPA 300.0
5/29/2012	Influent	Chromium Total ICAP	0.045	mg/L	0.01	EPA 200.7
5/29/2012	Influent	Hexavalent chromium(Dissolved)	44	ug/L	0.02	EPA 218.6
5/29/2012	Influent	Kjeldahl Nitrogen	0.26	mg/L	0.2	EPA 351.2
5/29/2012	Influent	Nitrate as Nitrogen by IC	20	mg/L	0.1	EPA 300.0
5/29/2012	Influent	Nitrate as NO3 (calc)	86	mg/L	0.44	EPA 300.0
5/29/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/29/2012	Influent	Perchlorate	94000	ug/L	4	EPA 314.0
5/29/2012	Influent	Total Inorganic Nitrogen-Calc	20	mg/L	0.2	CALC_300.0
5/29/2012	Influent	Total Nitrate, Nitrite-N, CALC	20	mg/L	0.1	EPA 300.0
5/29/2012	Influent	Total phosphorus as P	0.053	mg/L	0.02	SM4500-PE/EPA 365.1
5/29/2012	Effluent	Ammonia Nitrogen	0.15	mg/L	0.05	

**NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary**

<b>Sample Date</b>	<b>Sample ID</b>	<b>Analyte</b>	<b>Final</b>	<b>Units</b>	<b>MRL</b>	<b>Method</b>
5/29/2012	Effluent	Apparent Color	5	ACU	3	SM 2120B
5/29/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
5/29/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
5/29/2012	Effluent	Hexavalent chromium(Dissolved)	0.046	ug/L	0.02	EPA 218.6
5/29/2012	Effluent	Iron Total ICAP	3	mg/L	0.02	EPA 200.7
5/29/2012	Effluent	Kjeldahl-Nitrogen	1.1	mg/L	0.2	EPA 351.2
5/29/2012	Effluent	Nitrate as Nitrogen by IC	0.7	mg/L	0.013	EPA 300.0
5/29/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/29/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
5/29/2012	Effluent	pH	7.2	Units	0.1	SM4500-HB
5/29/2012	Effluent	Total Inorganic Nitrogen-Calc	0.86	mg/L	0.2	CALC_300.0
5/29/2012	Effluent	Total phosphorus as P	0.34	mg/L	0.02	SM4500-PE/EPA 365.1
5/29/2012	Effluent	Total Suspended Solids (TSS)	15	mg/L	10	
5/30/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
5/30/2012	Effluent	Carbonaceous BOD	11	mg/L	3	SM 5210B
6/4/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/4/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
6/4/2012	Influent	Chlorate by IC	240000	ug/L	10	EPA 300.0
6/4/2012	Influent	Chromium Total ICAP	0.039	mg/L	0.01	EPA 200.7
6/4/2012	Influent	Hexavalent chromium(Dissolved)	36	ug/L	0.02	EPA 218.6
6/4/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
6/4/2012	Influent	Nitrate as Nitrogen by IC	11	mg/L	0.1	EPA 300.0
6/4/2012	Influent	Nitrate as NO3 (calc)	48	mg/L	0.44	EPA 300.0
6/4/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/4/2012	Influent	Perchlorate	110000	ug/L	4	EPA 314.0
6/4/2012	Influent	Sulfate	1400	mg/L	0.5	EPA 300.0
6/4/2012	Influent	Sulfide,Total	ND	mg/L	0.05	SM4500SD/376.2
6/4/2012	Influent	Total Inorganic Nitrogen-Calc	11	mg/L	0.2	
6/4/2012	Influent	Total Nitrate, Nitrite-N, CALC	11	mg/L	0.1	EPA 300.0
6/4/2012	Influent	Total phosphorus as P	0.06	mg/L	0.02	SM4500-PE/EPA 365.1
6/4/2012	Effluent	Ammonia Nitrogen	0.14	mg/L	0.05	
6/4/2012	Effluent	Apparent Color	25	ACU	3	SM 2120B
6/4/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
6/4/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
6/4/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
6/4/2012	Effluent	Iron Total ICAP	4.3	mg/L	0.02	EPA 200.7
6/4/2012	Effluent	Kjeldahl Nitrogen	1.5	mg/L	0.2	EPA 351.2
6/4/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/4/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/4/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
6/4/2012	Effluent	pH	7.4	Units	0.1	SM4500-HB
6/4/2012	Effluent	Sulfate	1100	mg/L	0.5	EPA 300.0
6/4/2012	Effluent	Sulfide,Total	ND	mg/L	0.05	SM4500SD/376.2
6/4/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	
6/4/2012	Effluent	Total phosphorus as P	0.35	mg/L	0.02	SM4500-PE/EPA 365.1
6/4/2012	Effluent	Total Suspended Solids (TSS)	18	mg/L	10	
6/6/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
6/6/2012	Effluent	Carbonaceous BOD	5.1	mg/L	3	SM 5210B
6/11/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/11/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
6/11/2012	Influent	Chlorate by IC	200000	ug/L	10	EPA 300.0
6/11/2012	Influent	Chromium Total ICAP	0.037	mg/L	0.01	EPA 200.7
6/11/2012	Influent	Hexavalent chromium(Dissolved)	33	ug/L	0.02	EPA 218.6
6/11/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
6/11/2012	Influent	Nitrate as Nitrogen by IC	10	mg/L	0.1	EPA 300.0
6/11/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/11/2012	Influent	Perchlorate	110000	ug/L	4	EPA 314.0
6/11/2012	Influent	Total Inorganic Nitrogen-Calc	10	mg/L	0.2	CALC_300.0

**NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary**

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
6/11/2012	Influent	Total Nitrate, Nitrite-N, CALC	10	mg/L	0.1	EPA 300.0
6/11/2012	Influent	Total phosphorus as P	0.048	mg/L	0.02	SM4500-PE/EPA 365.1
6/11/2012	Effluent	Ammonia Nitrogen	0.074	mg/L	0.05	EPA 350.1
6/11/2012	Effluent	Apparent Color	25	ACU	3	SM 2120B
6/11/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
6/11/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
6/11/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
6/11/2012	Effluent	Iron Total ICAP	3.6	mg/L	0.02	EPA 200.7
6/11/2012	Effluent	Kjeldahl Nitrogen	0.72	mg/L	0.2	EPA 351.2
6/11/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/11/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/11/2012	Effluent	Perchlorate	ND	ug/L	4	EPA 314.0
6/11/2012	Effluent	pH	7.5	Units	0.1	SM4500-HB
6/11/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
6/11/2012	Effluent	Total phosphorus as P	0.12	mg/L	0.02	SM4500-PE/EPA 365.1
6/11/2012	Effluent	Total Suspended Solids (TSS)	14	mg/L	10	SM 2540D
6/13/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
6/13/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
6/18/2012	Influent	Ammonia Nitrogen	0.061	mg/L	0.05	EPA 350.1
6/18/2012	Influent	Apparent Color	5	ACU	3	SM 2120B
6/18/2012	Influent	Chlorate by IC	210000	ug/L	20	EPA 300.0
6/18/2012	Influent	Chromium Total ICAP	0.06	mg/L	0.01	EPA 200.7
6/18/2012	Influent	Hexavalent chromium(Dissolved)	58	ug/L	0.02	EPA 218.6
6/18/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
6/18/2012	Influent	Nitrate as Nitrogen by IC	11	mg/L	0.1	EPA 300.0
6/18/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/18/2012	Influent	Perchlorate	96000	ug/L	4	EPA 314.0
6/18/2012	Influent	Total Inorganic Nitrogen-Calc	11	mg/L	0.2	CALC_300.0
6/18/2012	Influent	Total Nitrate, Nitrite-N, CALC	11	mg/L	0.1	EPA 300.0
6/18/2012	Influent	Total phosphorus as P	0.048	mg/L	0.02	SM4500-PE/EPA 365.1
6/18/2012	Effluent	Alpha, Min Detectable Activity	1.42	pCi/L	0	SM 7110C
6/18/2012	Effluent	Alpha, Two Sigma Error	2.17	pCi/L	0	SM 7110C
6/18/2012	Effluent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/18/2012	Effluent	Apparent Color	40	ACU	3	SM 2120B
6/18/2012	Effluent	Chlorate by IC	ND	ug/L	20	EPA 300.0
6/18/2012	Effluent	Chromium Total ICAP	0.011	mg/L	0.01	EPA 200.7
6/18/2012	Effluent	Gross Alpha by Coprecipitation	18.2	pCi/L	1.42	SM 7110C
6/18/2012	Effluent	Hexavalent chromium(Dissolved)	ND	ug/L	0.02	EPA 218.6
6/18/2012	Effluent	Iron Total ICAP	4	mg/L	0.02	EPA 200.7
6/18/2012	Effluent	Kjeldahl Nitrogen	0.86	mg/L	0.2	EPA 351.2
6/18/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/18/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/18/2012	Effluent	Perchlorate	ND	ug/L	0.5	EPA 314.0
6/18/2012	Effluent	pH	7.3	Units	0.1	SM4500-HB
6/18/2012	Effluent	Total Inorganic Nitrogen-Calc	ND	mg/L	0.2	CALC_300.0
6/18/2012	Effluent	Total phosphorus as P	0.095	mg/L	0.02	SM4500-PE/EPA 365.1
6/20/2012	Effluent	Total Suspended Solids (TSS)	20	mg/L	10	SM 2540D
6/20/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
6/20/2012	Effluent	Carbonaceous BOD	3	mg/L	3	SM 5210B
6/25/2012	Influent	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/25/2012	Influent	Apparent Color	10	ACU	3	SM 2120B
6/25/2012	Influent	Chlorate by IC	210000	ug/L	10	EPA 300.0
6/25/2012	Influent	Chromium Total ICAP	0.048	mg/L	0.01	EPA 200.7
6/25/2012	Influent	Hexavalent chromium(Dissolved)	51	ug/L	0.02	EPA 218.6
6/25/2012	Influent	Kjeldahl Nitrogen	ND	mg/L	0.2	EPA 351.2
6/25/2012	Influent	Nitrate as Nitrogen by IC	10	mg/L	0.1	EPA 300.0
6/25/2012	Influent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/25/2012	Influent	Perchlorate	90000	ug/L	4	EPA 314.0

**NPDES Permit NV0023060 - 2nd Q 2012 - Influent and Effluent Analytical Summary**

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Final</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
6/25/2012	Influent	Total Inorganic Nitrogen-Calc	10	mg/L	0.2	CALC_300.0
6/25/2012	Influent	Total Nitrate, Nitrite-N, CALC	10	mg/L	0.1	EPA 300.0
6/25/2012	Influent	Total phosphorus as P	0.022	mg/L	0.02	SM4500-PE/EPA 365.1
6/25/2012	Effluent	Ammonia Nitrogen	0.23	mg/L	0.05	EPA 350.1
6/25/2012	Effluent	Apparent Color	20	ACU	3	SM 2120B
6/25/2012	Effluent	Chlorate by IC	ND	ug/L	10	EPA 300.0
6/25/2012	Effluent	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
6/25/2012	Effluent	Hexavalent chromium(Dissolved)	0.081	ug/L	0.02	EPA 218.6
6/25/2012	Effluent	Iron Total ICAP	2.1	mg/L	0.02	EPA 200.7
6/25/2012	Effluent	Kjeldahl Nitrogen	1.3	mg/L	0.2	EPA 351.2
6/25/2012	Effluent	Nitrate as Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/25/2012	Effluent	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/25/2012	Effluent	Perchlorate	ND	ug/L	1	EPA 314.0
6/25/2012	Effluent	pH	7.1	Units	0.1	SM4500-HB
6/25/2012	Effluent	Total Inorganic Nitrogen-Calc	0.23	mg/L	0.2	CALC_300.0
6/25/2012	Effluent	Total phosphorus as P	0.2	mg/L	0.02	SM4500-PE/EPA 365.1
6/25/2012	Effluent	Total Suspended Solids (TSS)	11	mg/L	10	SM 2540D
6/27/2012	Influent	Carbonaceous BOD	ND	mg/L	3	SM 5210B
6/27/2012	Effluent	Carbonaceous BOD	ND	mg/L	3	SM 5210B

**NPDES Permit NV0023060 - 2nd Q 12 - Influent and Effluent Perchlorate Analytical Summary**

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/7/2012	Influent-Comp	Perchlorate	120000	ug/L	4	EPA 314.0
4/7/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
4/14/2012	Influent-Comp	Perchlorate	100000	ug/L	4	EPA 314.0
4/14/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
4/21/2012	Influent-Comp	Perchlorate	110000	ug/L	4	EPA 314.0
4/21/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
4/28/2012	Influent-Comp	Perchlorate	110000	ug/L	4	EPA 314.0
4/28/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
5/5/2012	Influent-Comp	Perchlorate	120000	ug/L	4	EPA 314.0
5/5/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
5/12/2012	Influent-Comp	Perchlorate	120000	ug/L	4	EPA 314.0
5/12/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
5/19/2012	Influent-Comp	Perchlorate	100000	ug/L	4	EPA 314.0
5/19/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
5/26/2012	Influent-Comp	Perchlorate	98000	ug/L	4	EPA 314.0
5/26/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
6/2/2012	Influent-Comp	Perchlorate	100000	ug/L	4	EPA 314.0
6/2/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0
6/9/2012	Influent-Comp	Perchlorate	100000	ug/L	4	EPA 314.0
6/9/2012	Effluent-Comp	Perchlorate	ND	ug/L	0.5	EPA 314.0
6/16/2012	Influent-Comp	Perchlorate	95000	ug/L	4	EPA 314.0
6/16/2012	Effluent-Comp	Perchlorate	ND	ug/L	0.5	EPA 314.0
6/23/2012	Influent-Comp*	Perchlorate	105000	ug/L	20000	EPA 314.0
6/23/2012	Effluent-Comp*	Perchlorate	ND	ug/L	8	EPA 314.0
6/30/2012	Influent-Comp	Perchlorate	99000	ug/L	4	EPA 314.0
6/30/2012	Effluent-Comp	Perchlorate	ND	ug/L	4	EPA 314.0

\* Please note both the influent and effluent composite samples for the week dated 6/23/2012 did not include a sample from 6/19/2012, due to an error made during collection of the samples on 6/19/2012.

NPDES Permit NV0023060 - 2nd Q 12 - Wash Locations Analytical Summary

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/2/2012	LVW 0.55	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/2/2012	LVW 0.55	Perchlorate	56	ug/L	4	EPA 314.0
4/2/2012	LVW 0.55	Total phosphorus as P	0.052	mg/L	0.02	SM4500-P/EPA 365.1
4/2/2012	LVW 5.5	Alpha, Min Detectable Activity	2.5	pCi/L	0	SM 7110C
4/2/2012	LVW 5.5	Alpha, Two Sigma Error	1.79	pCi/L	0	SM 7110C
4/2/2012	LVW 5.5	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/2/2012	LVW 5.5	Apparent Color	15	ACU	3	SM 2120B
4/2/2012	LVW 5.5	Boron Total ICAP	0.59	mg/L	0.05	EPA 200.7
4/2/2012	LVW 5.5	Chloride	310	mg/L	1	EPA 300.0
4/2/2012	LVW 5.5	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/2/2012	LVW 5.5	Gross Alpha by Coprecipitation	4.34	pCi/L	2.5	SM 7110C
4/2/2012	LVW 5.5	Iron Total ICAP	0.085	mg/L	0.02	EPA 200.7
4/2/2012	LVW 5.5	Manganese Total ICAP	0.038	mg/L	0.002	EPA 200.7
4/2/2012	LVW 5.5	Nitrate as Nitrogen by IC	13	mg/L	0.1	EPA 300.0
4/2/2012	LVW 5.5	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/2/2012	LVW 5.5	Perchlorate	20	ug/L	4	EPA 314.0
4/2/2012	LVW 5.5	Total Dissolved Solids (TDS)	1500	mg/L	10	E160.1/SM2540C
4/2/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0
4/2/2012	LVW 6.05	Alpha, Min Detectable Activity	1.83	pCi/L	0	SM 7110C
4/2/2012	LVW 6.05	Alpha, Two Sigma Error	1.74	pCi/L	0	SM 7110C
4/2/2012	LVW 6.05	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/2/2012	LVW 6.05	Apparent Color	15	ACU	3	SM 2120B
4/2/2012	LVW 6.05	Boron Total ICAP	0.56	mg/L	0.05	EPA 200.7
4/2/2012	LVW 6.05	Chloride	320	mg/L	1	EPA 300.0
4/2/2012	LVW 6.05	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/2/2012	LVW 6.05	Gross Alpha by Coprecipitation	4.87	pCi/L	1.83	SM 7110C
4/2/2012	LVW 6.05	Iron Total ICAP	0.14	mg/L	0.02	EPA 200.7
4/2/2012	LVW 6.05	Manganese Total ICAP	0.036	mg/L	0.002	EPA 200.7
4/2/2012	LVW 6.05	Nitrate as Nitrogen by IC	13	mg/L	0.1	EPA 300.0
4/2/2012	LVW 6.05	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/2/2012	LVW 6.05	Perchlorate	20	ug/L	4	EPA 314.0
4/2/2012	LVW 6.05	Total Dissolved Solids (TDS)	1600	mg/L	10	E160.1/SM2540C
4/2/2012	LVW 6.05	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0
4/2/2012	LVW UPGRADIENT	Alpha, Min Detectable Activity	1.71	pCi/L	0	SM 7110C
4/2/2012	LVW UPGRADIENT	Alpha, Two Sigma Error	1.75	pCi/L	0	SM 7110C
4/2/2012	LVW UPGRADIENT	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/2/2012	LVW UPGRADIENT	Apparent Color	15	ACU	3	SM 2120B
4/2/2012	LVW UPGRADIENT	Boron Total ICAP	0.57	mg/L	0.05	EPA 200.7
4/2/2012	LVW UPGRADIENT	Chloride	280	mg/L	1	EPA 300.0
4/2/2012	LVW UPGRADIENT	Chromium Total ICAP	ND	mg/L	0.01	EPA 200.7
4/2/2012	LVW UPGRADIENT	Gross Alpha by Coprecipitation	5.13	pCi/L	1.71	SM 7110C
4/2/2012	LVW UPGRADIENT	Iron Total ICAP	0.11	mg/L	0.02	EPA 200.7
4/2/2012	LVW UPGRADIENT	Manganese Total ICAP	0.032	mg/L	0.002	EPA 200.7
4/2/2012	LVW UPGRADIENT	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
4/2/2012	LVW UPGRADIENT	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/2/2012	LVW UPGRADIENT	Perchlorate	22	ug/L	4	EPA 314.0
4/2/2012	LVW UPGRADIENT	Total Dissolved Solids (TDS)	1600	mg/L	10	E160.1/SM2540C
4/2/2012	LVW UPGRADIENT	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
4/16/2012	LVW 0.55	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/16/2012	LVW 0.55	Perchlorate	48	ug/L	4	EPA 314.0
4/16/2012	LVW 0.55	Total phosphorus as P	ND	mg/L	0.02	SM4500-PE/EPA 365.1
4/16/2012	LVW 5.5	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/16/2012	LVW 5.5	Nitrate as Nitrogen by IC	11	mg/L	0.1	EPA 300.0
4/16/2012	LVW 5.5	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/16/2012	LVW 5.5	Perchlorate	26	ug/L	4	EPA 314.0
4/16/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	11	mg/L	0.2	CALC_300.0
4/16/2012	LVW 6.05	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/16/2012	LVW 6.05	Nitrate as Nitrogen by IC	10	mg/L	0.1	EPA 300.0

**NPDES Permit NV0023060 - 2nd Q 12 - Wash Locations Analytical Summary**

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>MRL</u>	<u>Method</u>
4/16/2012	LVW 6.05	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/16/2012	LVW 6.05	Perchlorate	24	ug/L	4	EPA 314.0
4/16/2012	LVW 6.05	Total Inorganic Nitrogen-Calc	10	mg/L	0.2	CALC_300.0
4/16/2012	LVW UPGRADIENT	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
4/16/2012	LVW UPGRADIENT	Nitrate as Nitrogen by IC	12	mg/L	0.1	EPA 300.0
4/16/2012	LVW UPGRADIENT	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
4/16/2012	LVW UPGRADIENT	Perchlorate	27	ug/L	4	EPA 314.0
4/16/2012	LVW UPGRADIENT	Total Inorganic Nitrogen-Calc	12	mg/L	0.2	CALC_300.0
5/7/2012	LVW 0.55	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/7/2012	LVW 0.55	Perchlorate	38	ug/L	4	EPA 314.0
5/7/2012	LVW 0.55	Total phosphorus as P	0.045	mg/L	0.02	SM4500-PE/EPA 365.1
5/7/2012	LVW 5.5	Alpha, Min Detectable Activity	1.92	pCi/L	0	
5/7/2012	LVW 5.5	Alpha, Two Sigma Error	1.58	pCi/L	0	SM 7110C
5/7/2012	LVW 5.5	Ammonia Nitrogen	0.096	mg/L	0.05	EPA 350.1
5/7/2012	LVW 5.5	Gross Alpha by Coprecipitation	3.68	pCi/L	1.92	SM 7110C
5/7/2012	LVW 5.5	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
5/7/2012	LVW 5.5	Nitrite Nitrogen by IC	ND	mg/L	0.05	EPA 300.0
5/7/2012	LVW 5.5	Perchlorate	27	ug/L	4	EPA 314.0
5/7/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
5/7/2012	LVW 6.05	Alpha, Min Detectable Activity	2.07	pCi/L	0	SM 7110C
5/7/2012	LVW 6.05	Alpha, Two Sigma Error	1.22	pCi/L	0	SM 7110C
5/7/2012	LVW 6.05	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/7/2012	LVW 6.05	Gross Alpha by Coprecipitation	<2.07	pCi/L	2.07	SM 7110C
5/7/2012	LVW 6.05	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
5/7/2012	LVW 6.05	Nitrite Nitrogen by IC	ND	mg/L	0.05	EPA 300.0
5/7/2012	LVW 6.05	Perchlorate	15	ug/L	4	EPA 314.0
5/7/2012	LVW 6.05	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
5/7/2012	LVW UPGRADIENT	Alpha, Min Detectable Activity	0.788	pCi/L	0	SM 7110C
5/7/2012	LVW UPGRADIENT	Alpha, Two Sigma Error	0.561	pCi/L	0	SM 7110C
5/7/2012	LVW UPGRADIENT	Ammonia Nitrogen	0.11	mg/L	0.05	EPA 350.1
5/7/2012	LVW UPGRADIENT	Gross Alpha by Coprecipitation	2.1	pCi/L	0.788	SM 7110C
5/7/2012	LVW UPGRADIENT	Nitrate as Nitrogen by IC	13	mg/L	0.1	EPA 300.0
5/7/2012	LVW UPGRADIENT	Nitrite Nitrogen by IC	ND	mg/L	0.05	EPA 300.0
5/7/2012	LVW UPGRADIENT	Perchlorate	25	ug/L	4	EPA 314.0
5/7/2012	LVW UPGRADIENT	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
5/21/2012	LVW 0.55	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/21/2012	LVW 0.55	Perchlorate	47	ug/L	4	EPA 314.0
5/21/2012	LVW 0.55	Total phosphorus as P	0.034	mg/L	0.02	SM4500-PE/EPA 365.1
5/21/2012	LVW 5.5	Alpha, Min Detectable Activity	1.42	pCi/L	0	
5/21/2012	LVW 5.5	Alpha, Two Sigma Error	1.29	pCi/L	0	SM 7110C
5/21/2012	LVW 5.5	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/21/2012	LVW 5.5	Gross Alpha by Coprecipitation	2.83	pCi/L	1.42	SM 7110C
5/21/2012	LVW 5.5	Nitrate as Nitrogen by IC	15	mg/L	0.1	EPA 300.0
5/21/2012	LVW 5.5	Nitrite Nitrogen by IC	ND	mg/L	0.05	EPA 300.0
5/21/2012	LVW 5.5	Perchlorate	22	ug/L	4	EPA 314.0
5/21/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	15	mg/L	0.2	CALC_300.0
5/21/2012	LVW 6.05	Alpha, Min Detectable Activity	1.96	pCi/L	0	SM 7110C
5/21/2012	LVW 6.05	Alpha, Two Sigma Error	1.48	pCi/L	0	SM 7110C
5/21/2012	LVW 6.05	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/21/2012	LVW 6.05	Gross Alpha by Coprecipitation	3.3	pCi/L	1.96	SM 7110C
5/21/2012	LVW 6.05	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
5/21/2012	LVW 6.05	Nitrite Nitrogen by IC	ND	mg/L	0.05	EPA 300.0
5/21/2012	LVW 6.05	Perchlorate	22	ug/L	4	EPA 314.0
5/21/2012	LVW 6.05	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
5/21/2012	LVW UPGRADIENT	Alpha, Min Detectable Activity	0.741	pCi/L	0	SM 7110C
5/21/2012	LVW UPGRADIENT	Alpha, Two Sigma Error	0.865	pCi/L	0	SM 7110C
5/21/2012	LVW UPGRADIENT	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/21/2012	LVW UPGRADIENT	Gross Alpha by Coprecipitation	3.31	pCi/L	0.741	SM 7110C

**NPDES Permit NV0023060 - 2nd Q 12 - Wash Locations Analytical Summary**

<u>Sample Date</u>	<u>Sample ID</u>	<u>Analyte</u>	<u>Result</u>	<u>Units</u>	<u>MRI</u>	<u>Method</u>
5/21/2012	LVW UPGRAIDENT	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
5/21/2012	LVW UPGRAIDENT	Nitrite Nitrogen by IC	ND	mg/L	0.05	EPA 300.0
5/21/2012	LVW UPGRAIDENT	Perchlorate	21	ug/L	4	EPA 314.0
5/21/2012	LVW UPGRAIDENT	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
6/4/2012	LVW 0.55	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/4/2012	LVW 0.55	Perchlorate	42	ug/L	4	EPA 314.0
6/4/2012	LVW 0.55	Total phosphorus as P	0.098	mg/L	0.02	SM4500-PE/EPA 365.1
6/4/2012	LVW 5.5	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/4/2012	LVW 5.5	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
6/4/2012	LVW 5.5	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/4/2012	LVW 5.5	Perchlorate	20	ug/L	4	EPA 314.0
6/4/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
6/4/2012	LVW 6.05	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/4/2012	LVW 6.05	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
6/4/2012	LVW 6.05	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/4/2012	LVW 6.05	Perchlorate	20	ug/L	4	EPA 314.0
6/4/2012	LVW 6.05	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
6/4/2012	LVW UPGRAIDENT	Ammonia Nitrogen	0.067	mg/L	0.05	EPA 350.1
6/4/2012	LVW UPGRAIDENT	Nitrate as Nitrogen by IC	14	mg/L	0.1	EPA 300.0
6/4/2012	LVW UPGRAIDENT	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/4/2012	LVW UPGRAIDENT	Perchlorate	22	ug/L	4	EPA 314.0
6/4/2012	LVW UPGRAIDENT	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0
6/18/2012	LVW 0.55	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/18/2012	LVW 0.55	Perchlorate	47	ug/L	2	EPA 314.0
6/18/2012	LVW 0.55	Total phosphorus as P	0.1	mg/L	0.02	SM4500-PE/EPA 365.1
6/18/2012	LVW 5.5	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/18/2012	LVW 5.5	Nitrate as Nitrogen by IC	13	mg/L	0.1	EPA 300.0
6/18/2012	LVW 5.5	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/18/2012	LVW 5.5	Perchlorate	23	ug/L	2	EPA 314.0
6/18/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0
6/18/2012	LVW 6.05	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/18/2012	LVW 6.05	Nitrate as Nitrogen by IC	13	mg/L	0.1	EPA 300.0
6/18/2012	LVW 6.05	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/18/2012	LVW 6.05	Perchlorate	22	ug/L	2	EPA 314.0
6/18/2012	LVW 6.05	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0
6/18/2012	LVW UPGRAIDENT	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
6/18/2012	LVW UPGRAIDENT	Nitrate as Nitrogen by IC	13	mg/L	0.1	EPA 300.0
6/18/2012	LVW UPGRAIDENT	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
6/18/2012	LVW UPGRAIDENT	Perchlorate	24	ug/L	2	EPA 314.0
6/18/2012	LVW UPGRAIDENT	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0

**NPDES Permit NV0023060 - 2nd Q 12 - Wash Locations Analytical Summary**

<b><u>Sample Date</u></b>	<b><u>Sample ID</u></b>	<b><u>Analyte</u></b>	<b><u>Result</u></b>	<b><u>Units</u></b>	<b><u>MRL</u></b>	<b><u>Method</u></b>	<b><u>Mix Zone Limits</u></b>
4/2/2012	LVW 5.5	Total Dissolved Solids (TDS)	1500	mg/L	10	E160.1/SM2540C	2400
4/2/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0	17
4/16/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	11	mg/L	0.2	CALC_300.0	"
5/7/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0	"
5/21/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	15	mg/L	0.2	CALC_300.0	"
6/4/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	14	mg/L	0.2	CALC_300.0	"
6/18/2012	LVW 5.5	Total Inorganic Nitrogen-Calc	13	mg/L	0.2	CALC_300.0	"

**NPDES Permit NV0023060 - 2nd Q 12 - Upgradient Well Analytical Summary**

<b>Sample Date</b>	<b>Sample ID</b>	<b>Analyte</b>	<b>Result</b>	<b>Units</b>	<b>MRL</b>	<b>Method</b>
5/21/2012	M-10	Total Inorganic Nitrogen-Calc	1.7	mg/L	0.2	CALC_300.0
5/21/2012	M-10	Total Dissolved Solids (TDS)	2800	mg/L	10	E160.1/SM2540C
5/21/2012	M-10	Total Dissolved Solids (TDS)	2800	mg/L	10	E160.1/SM2540C
5/21/2012	M-10	Boron Total ICAP	2.8	mg/L	0.05	EPA 200.7
5/21/2012	M-10	Chromium Total ICAP	0.54	mg/L	0.01	EPA 200.7
5/21/2012	M-10	Iron Total ICAP	4.7	mg/L	0.02	EPA 200.7
5/21/2012	M-10	Manganese Total ICAP	0.17	mg/L	0.002	EPA 200.7
5/21/2012	M-10	Chloride	260	mg/L	1	EPA 300.0
5/21/2012	M-10	Nitrate as Nitrogen by IC	1.7	mg/L	0.1	EPA 300.0
5/21/2012	M-10	Nitrite Nitrogen by IC	ND	mg/L	0.013	EPA 300.0
5/21/2012	M-10	Nitrate as Nitrogen by IC	1.8	mg/L	0.1	EPA 300.0
5/21/2012	M-10	Nitrate as NO <sub>3</sub> (calc)	8	mg/L	0.44	EPA 300.0
5/21/2012	M-10	Perchlorate	13000	ug/L	4	EPA 314.0
5/21/2012	M-10	Ammonia Nitrogen	ND	mg/L	0.05	EPA 350.1
5/21/2012	M-10	Chromium Total ICAP	0.52	mg/L	0.01	EPA 6010
5/21/2012	M-10	Hexavalent chromium (Cr VI)	0.032	mg/L	0.005	EPA 7196
5/21/2012	M-10	pH	7.4	Units	0.1	EPA 9040
5/21/2012	M-10	Chlorate by IC	120000	ug/L	10	EPA 9056
5/21/2012	M-10	Nitrate as Nitrogen by IC	1.8	mg/L	0.1	EPA 9056
5/21/2012	M-10	Nitrate as NO <sub>3</sub> (calc)	8	mg/L	0.44	EPA 9056


**NPDES Permit NV0023060 - 2nd Q 12 - FBR Biosolids Analytical Summary**

<b>Sample Date</b>	<b>Sample ID</b>	<b>Analyte</b>	<b>Result</b>	<b>Units</b>	<b>MRL</b>	<b>Method</b>
4/2/2012	FBR BIOLOGICAL SOLIDS	Arsenic	550	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Cadmium	1.0 J	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Chromium	590	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Copper	230	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Lead	1.6 J	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Molybdenum	1500	mg/kg	23	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Nickel	35	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Selenium	69	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Silver	ND	mg/kg	4.6	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Zinc	300	mg/kg	9.3	EPA 6010
4/2/2012	FBR BIOLOGICAL SOLIDS	Mercury	ND	mg/kg	0.5	EPA 7471A
4/2/2012	FBR BIOLOGICAL SOLIDS	4,4-DDD	32	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	4,4-DDE	ND	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	4,4-DDT	35	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Aldrin	ND	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Alpha-BHC	240	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Alpha-Chlordane	ND	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Beta-BHC	220	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Delta-BHC	340	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Dieldrin	ND	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Endosulfan I	ND	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Endosulfan II	ND	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Endosulfan sulfate	ND	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Endrin	ND	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Endrin Aldehyde	ND	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Endrin Ketone	ND	ug/kg	20	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Gamma-BHC	ND	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Gamma-Chlordane	ND	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Heptachlor	ND	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Heptachlor Epoxide	ND	ug/kg	10	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Methoxychlor	ND	ug/kg	100	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	Toxaphene	ND	ug/kg	250	EPA 8081A
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1016	ND	ug/kg	250	EPA 8082
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1016 Aroclor	ND	ug/kg	250	EPA 8082
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1221 Aroclor	ND	ug/kg	250	EPA 8082
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1232 Aroclor	ND	ug/kg	250	EPA 8082
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1242 Aroclor	ND	ug/kg	250	EPA 8082
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1248 Aroclor	ND	ug/kg	250	EPA 8082
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1254 Aroclor	ND	ug/kg	250	EPA 8082
4/2/2012	FBR BIOLOGICAL SOLIDS	PCB 1260 Aroclor	ND	ug/kg	250	EPA 8082

J - The analyte was either detected at or greater than the SQL and less than the MRL, or did not meet any one of the required QC criteria.

## ATTACHMENT 3

### Supporting Analytical Reports

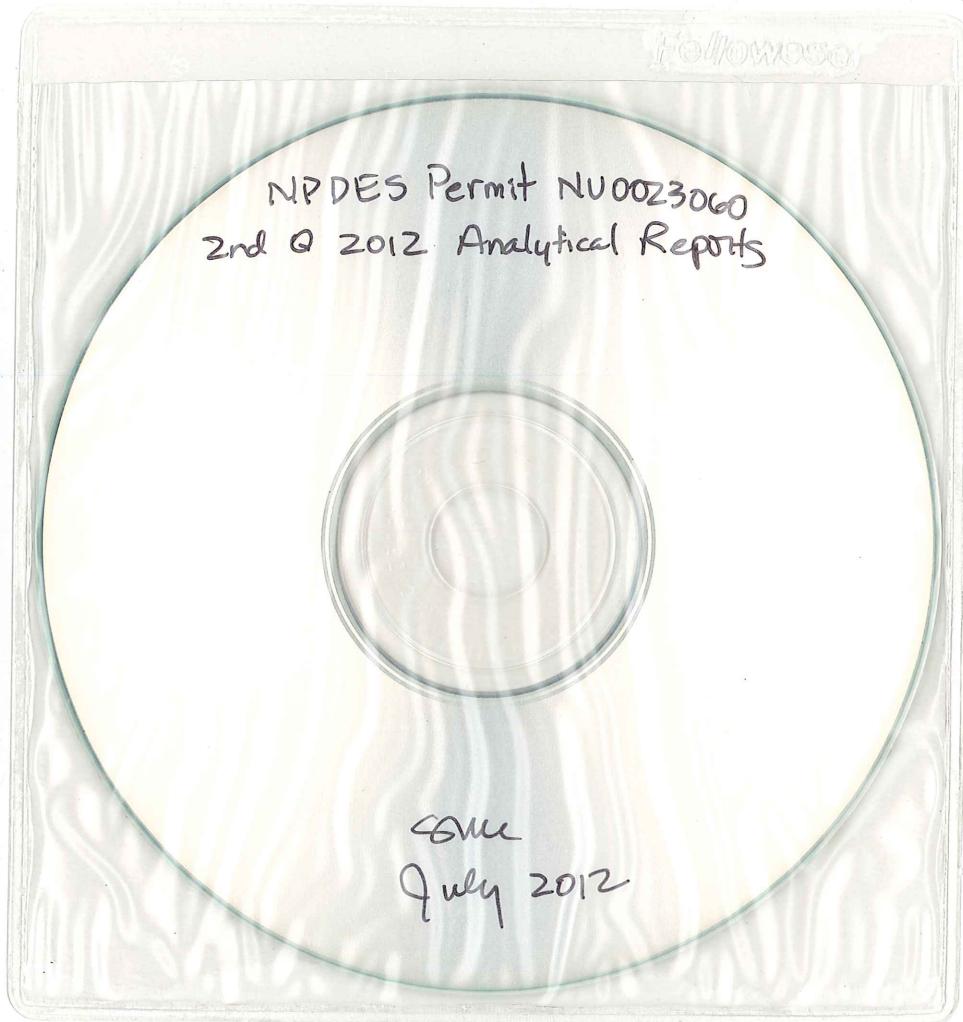

I hereby certify that all laboratory analytical data was generated by a laboratory certified by the NDEP for each constituent and media presented herein, exceptions and corresponding justifications are provided below.

Susan M. Crowley  
Susan M. Crowley, CEM 1428, exp 3-8-13

## **ATTACHMENT 4**

### **FBR Solids Report**

**(Analytical report included on CD in Attachment 3)**



2nd Quarter 2012  
Sludge Report submit



July 17, 2012

RE: FBR Biological Solids 2nd Quarter Reporting

To whom it may concern,

The NDEP Authorization to Discharge Permit No. NV0023060 section I.A.11 requires facilities that generate and dispose of sludge to monitor certain constituents; the frequency of monitoring depends on the amount of sludge produced.

The FBR Perchlorate Reduction Process generated 25.99 dry metric tons of biological solids in the second quarter of 2012. This extrapolates to an expected production of 103.97 metric TPY of dry FBR biological solids.

Attached for your review is the 2nd Quarter 2012 sludge monitoring results reported in mg/kg of dry sludge based on MWH Laboratories analysis (MWH Service Report #392849 for Environ International Corp.)

Please contact me if there are any questions. I will send a hard copy by mail with the attachments.

Sincerely,

A handwritten signature in black ink, appearing to read "RS".

Russell Speckin  
Veolia Water

CC: Via email w/ attachments

Steve Kubacki

Sachin Chawla

**Veolia Water North America**  
PO Box 90578 Henderson, NV 89009  
Tel 702-566-6001/Fax 702-566-9030  
[www.Veoliawaterna.com](http://www.Veoliawaterna.com)

All Ticket Types  
History and Waiting

**Detail Contract Activity Report**  
April 01, 2012 to June 30, 2012  
Specific Contract: ET-INTERCO VEOLIA WATER

All Facilities

ET-INTERCO VEOLIA WATER

Ticket Date	Facility & Ticket Number	Customer	Truck	Material	Billing Quantity	Ordered Quantity	Minimum Quantity	Item
04/04/2012 I	70 94525	099017 - ET - INTERCO	5068	SW-SLUDGE	9.72 TN	0.00	\$0.00	
04/09/2012 I	70 94787	099017 - ET - INTERCO	5068	SW-SLUDGE	1.42 TN	0.00	\$0.00	
04/17/2012 I	70 95206	099017 - ET - INTERCO	6130	SW-SLUDGE	10.88 TN	0.00	\$0.00	
04/21/2012 I	70 95481	099017 - ET - INTERCO	6135	SW-SLUDGE	7.32 TN	0.00	\$0.00	
04/25/2012 I	70 95733	099017 - ET - INTERCO	5068	SW-SLUDGE	6.09 TN	0.00	\$0.00	
05/01/2012 I	70 96144	099017 - ET - INTERCO	6150	SW-SLUDGE	6.21 TN	0.00	\$0.00	
05/04/2012 I	70 96402	099017 - ET - INTERCO	6133	SW-SLUDGE	2.15 TN	0.00	\$0.00	
05/08/2012 I	70 96701	099017 - ET - INTERCO	6101	SW-SLUDGE	4.74 TN	0.00	\$0.00	
05/12/2012 I	70 97077	099017 - ET - INTERCO	6128	SW-SLUDGE	5.45 TN	0.00	\$0.00	
05/21/2012 I	70 98274	099017 - ET - INTERCO	5068	SW-SLUDGE	8.92 TN	0.00	\$0.00	
05/25/2012 I	70 98670	099017 - ET - INTERCO	5068	SW-SLUDGE	8.82 TN	0.00	\$0.00	
05/30/2012 I	70 98959	099017 - ET - INTERCO	5068	SW-SLUDGE	7.59 TN	0.00	\$0.00	
06/04/2012 I	70 99429	099017 - ET - INTERCO	5068	SW-SLUDGE	7.22 TN	0.00	\$0.00	
06/09/2012 I	70 100023	099017 - ET - INTERCO	6139	SW-SLUDGE	6.33 TN	0.00	\$0.00	
06/13/2012 I	70 100236	099017 - ET - INTERCO	5068	SW-SLUDGE	6.91 TN	0.00	\$0.00	
06/20/2012 I	70 100672	099017 - ET - INTERCO	5068	SW-SLUDGE	6.75 TN	0.00	\$0.00	
06/27/2012 I	70 101090	099017 - ET - INTERCO	6114	SW-SLUDGE	9.28 TN	0.00	\$0.00	

Tickets Reported: 17 Items Reported: 17

Contract Totals:

Material Summary	Inbound Weight	Outbound	Volume Inbound	Volume Outbound	Count Inbound	Count Outbound	Billing Quantity	Material Total	Tax Total	Total
WA - SW-SLUDGE	115.80	0.00 TN	0.00	0.00 YD	0.00	0.00	115.80 TN			

Cash Totals:
Invoice Totals:
Report Totals: