

Jim Hampton

From: Harvey, Lisa [LHarvey@nvenergy.com]
Sent: Thursday, July 08, 2010 9:31 AM
To: 'jim.hampton@ngem.com'
Subject: Information
Attachments: DOC070810.pdf

Here is the trenching detail and application.

You will notice the application at the bottom asked for an owner signature, I do not need the owner. Just whoever will be the contact for this. If you have any questions please let me know

Thanks!

Lisa Harvey
NV Energy- Land Services
Right-of-Way Administrator
Transmission conflicts
Office-702-402-5327
Cell- 702-277-3249

-----Original Message-----

From: PER005 [mailto:PER005]
Sent: Thursday, July 08, 2010 10:23 AM
To: Harvey, Lisa
Subject: Scanned from PER005 07/08/2010 09:22

Scanned from PER005.
Date: 07/08/2010 09:22
Pages:3
Resolution:200x200 DPI


NOTICE: The information contained in this electronic transmission is intended only for the use of the individual or entity named above. ANY DISTRIBUTION OR COPYING OF THIS MESSAGE IS PROHIBITED, except by the intended recipient(s). Attempts to intercept this message are in violation of 18 U.S.C. 2511(1) of the Electronic Communications Privacy Act, which subjects the interceptor to fines, imprisonment and/or civil damages. If you are not the intended recipient(s), please delete it and notify me.

REQUIREMENTS:

MAINTAIN A RADIUS OF 10' 1:1 SLOPE OF UNDISTURBED SOIL AROUND POLES.

IF TRENCH IS WITHIN THE 1:1 SLOPE THEN A TRENCH SHORING DWG MUST BE SUBMITTED, P.E. STAMPED, FOR NPC APPROVAL.

IF TRENCH IS WITHIN THE PRESCRIBED 10' RADIUS, POLE MUST BE BRACED BY NVE OR NVE CONTRACTOR AT CUSTOMER/DEVELOPER SOLE COST. ADDITIONALLY, TRENCH MUST BE SHORED AS NOTED ABOVE.

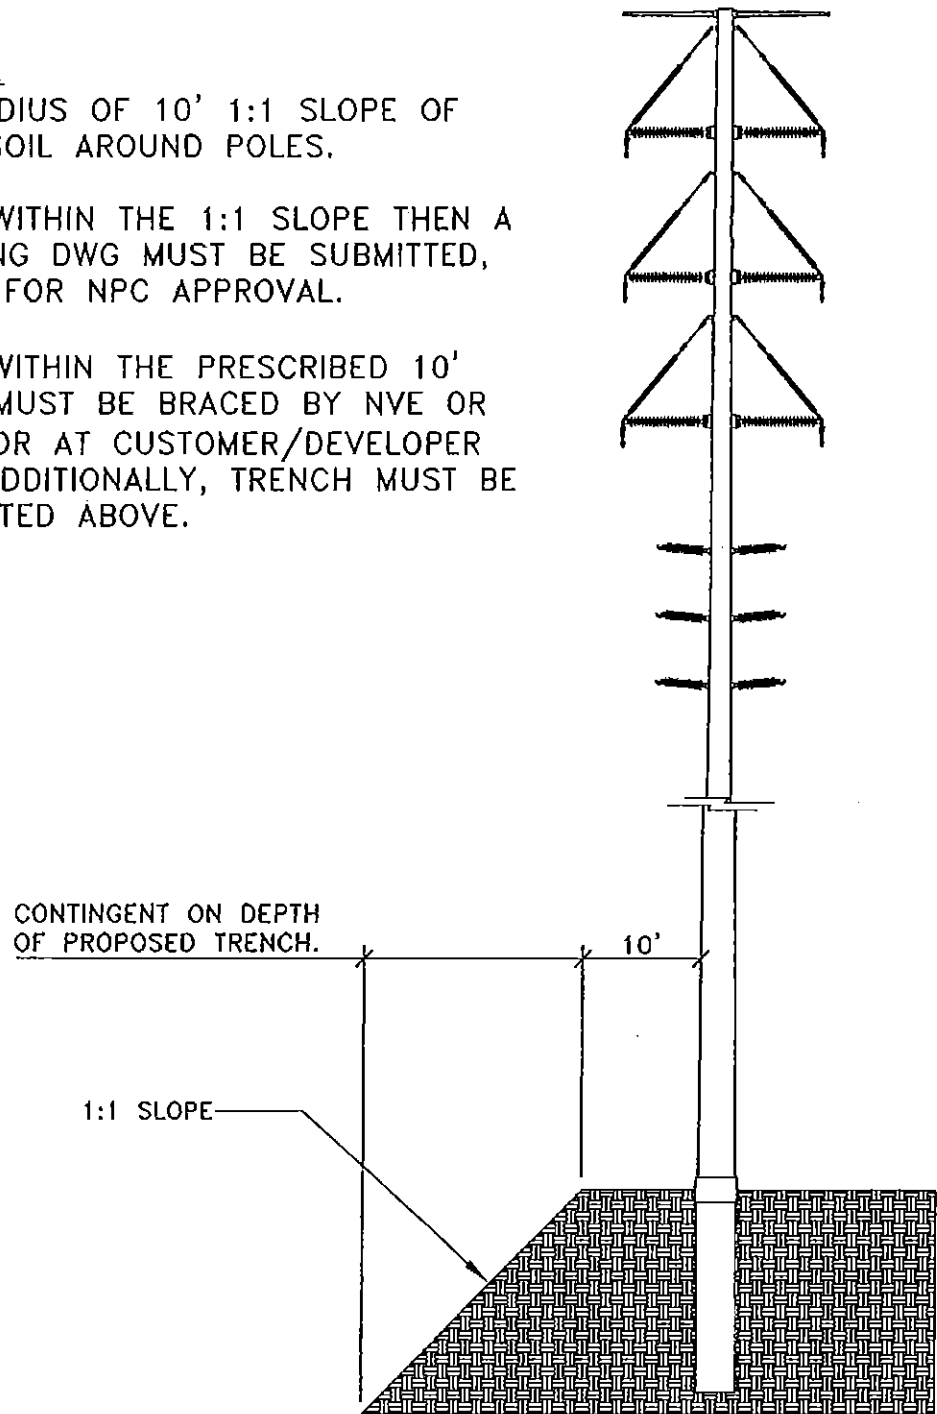

DRAWING INFO.		
DRAWN	6/12/01	JLH
DESIGNED	6/12/01	JLH
CHECKED	6/12/01	SA
APPROVED	6/12/01	SA
	DATE	BY
REV. 1	11/12/08	DP



TRENCH DETAIL	
POLE STABILITY	
SHEET: 1 OF 1	DWG. NO.: STD-02

U:\NPC\TD\VOL1\TRANSCOM\CONFLICT\CONFLICT STANDARDS\CONTROLLED MASTER FILES\D2 TRENCH DETAIL POLE STABILITY.DWG